



JOINT IMPLEMENTATION PROJECT DESIGN DOCUMENT FORM
Version 01 – in effect as of 15 June 2006

CONTENTS

- A. General description of the project
- B. Baseline
- C. Duration of the project / crediting period
- D. Monitoring plan
- E. Estimation of greenhouse gas emission reductions
- F. Environmental impacts
- G. Stakeholders' comments

Annexes

Annex 1: Contact information on project participants

Annex 2: Baseline information

Annex 3: Monitoring plan

**SECTION A. General description of the project****A.1. Title of the project:**

Avoidance of emissions in power stations through CMM utilisation on the Pniowek Coal Mine in Upper Silesian Basin, Poland. Project acronym: Pniowek-power

(Polish name of the mine is Pniówek. The English notation "Pniowek" is applied for this PDD)

Sectoral scopes 8, 10

Document Version: 5

Date: 18 October 2012

Prepared by: Carbon-TF B.V. Alina Mroz,

A.2. Description of the project:

The Upper Silesian Basin is the largest industrial region of Poland with coal, metallurgic and chemical industries. After the long term industrial use Upper Silesia is one of the most hazardous regions of Poland in terms of environmental pollution. The main contributor of methane emissions to the atmosphere is the coal industry.

Degassing of Coal Mine Gas (CMM) is an unavoidable occurrence of hard coal mining. CMM mainly consists of the harmful greenhouse gas methane (GWP 21), so that using of CMM becomes more important particularly with regard to the world-wide consensus of reducing green-house-gas emissions.

In this project CMM from the suction systems of the coal mine Pniowek should be utilised for heat and power generation for a innovative mine cooling plant. The project constellation is similar as other contracting solutions. The Project developer (Spolka Energetyczna Jastrzebie, SEJ) buys the CMM from its parent company Jastrzebska Spolka Weglowa (JSW) and sells then the produced power and heat to JSW.

The coal mine Pniowek has six shafts, three of them are for venting. The degassing of the mine is operated by a specialised Polish company ZOK, which has no relationships regarding capital shares with SEJ or JSW.

The presented project at the coal mine Pniowek was the first Polish project aiming a CMM utilisation by means of CHP with power production and additional heat production for an air conditioning of the mine. There were 3 methane burning systems for the heat generation already installed. The heat used by the coal mine facilities was generated by old coal fired boilers. All power was purchased from the Polish grid. In this project two units were 2000 installed and fired with CMM with the aim to deliver power to the mine and heat to the air condition plant and other heating plants of the mine. Although the biggest emission reduction is achieved by the burning of methane to less harmful carbon dioxide only the emission reduction through avoidance of power and heat production in plants fuelled with fossil fuels is claimed.

After the Marrakesh Accords projects implemented since 2000 can be presented for the JI registration claiming the ERUs generated after 01.01.2008. Furthermore after the law from 28.04.2011 projects causing emission reduction in power stations can be presented as JI after first track in Poland, if there is



no double counting. Double counting is not in place if there is a set-aside established in the national allocation plan of the host country for such projects.

**A.3. Project participants:***Table A- 1 – Project participants*

Party involved (*)	Legal entity <u>project participant</u> (as applicable)	Please indicate if the <u>Party involved</u> wishes to be considered as <u>project participant</u> (Yes/No)
Poland (host)	▪ Spolka Energetyczna “Jastrzebie” (SEJ)	No
Netherlands	▪ Carbon-TF B.V.	No
((host) indicates a host Party)		

- Carbon-TF B.V.
Consultant and investor, buyer of the emission reduction units; Dutch company trading emissions reduction certificates. Authorised to participate in the project
- Spolka Energetyczna “Jastrzebie” SA (SEJ)
Project developer, subsidiary of the coal mining company Jastrzebska Spolka Weglowa SA. SEJ buys the CMM from its parent company with a view to utilise the gas and sells the produced power and heat to the mine Pniowek. Owner of the plant.

A.4. Technical description of the project:**A.4.1. Location of the project:**

The project is located at the coal mine Pniowek in Pawlowice in south Poland (Silesian Voivodship). The locations of the Upper Silesian basin as well as location of the coal mine are shown on the maps below.

A.4.1.1. Host Party(ies):

Host Party: Poland

A.4.1.2. Region/State/Province etc.:



Figure A- 1: Location of the Upper Silesian Basin in Poland

A.4.1.3. City/Town/Community etc.:

Location of project: the project is located in the Upper Silesia Basin, on the working coal mine Pniówek, EEG "Pniówek" ul. Krucza 18, PL-43-251 Pawłowice Śląskie, Silesian Voivodship
Boundary: Pawłowice, Poland.

Land parcel: 568 / 37

Geographical coordinates: 49° 57'58.28"N 18°41'28.55"E


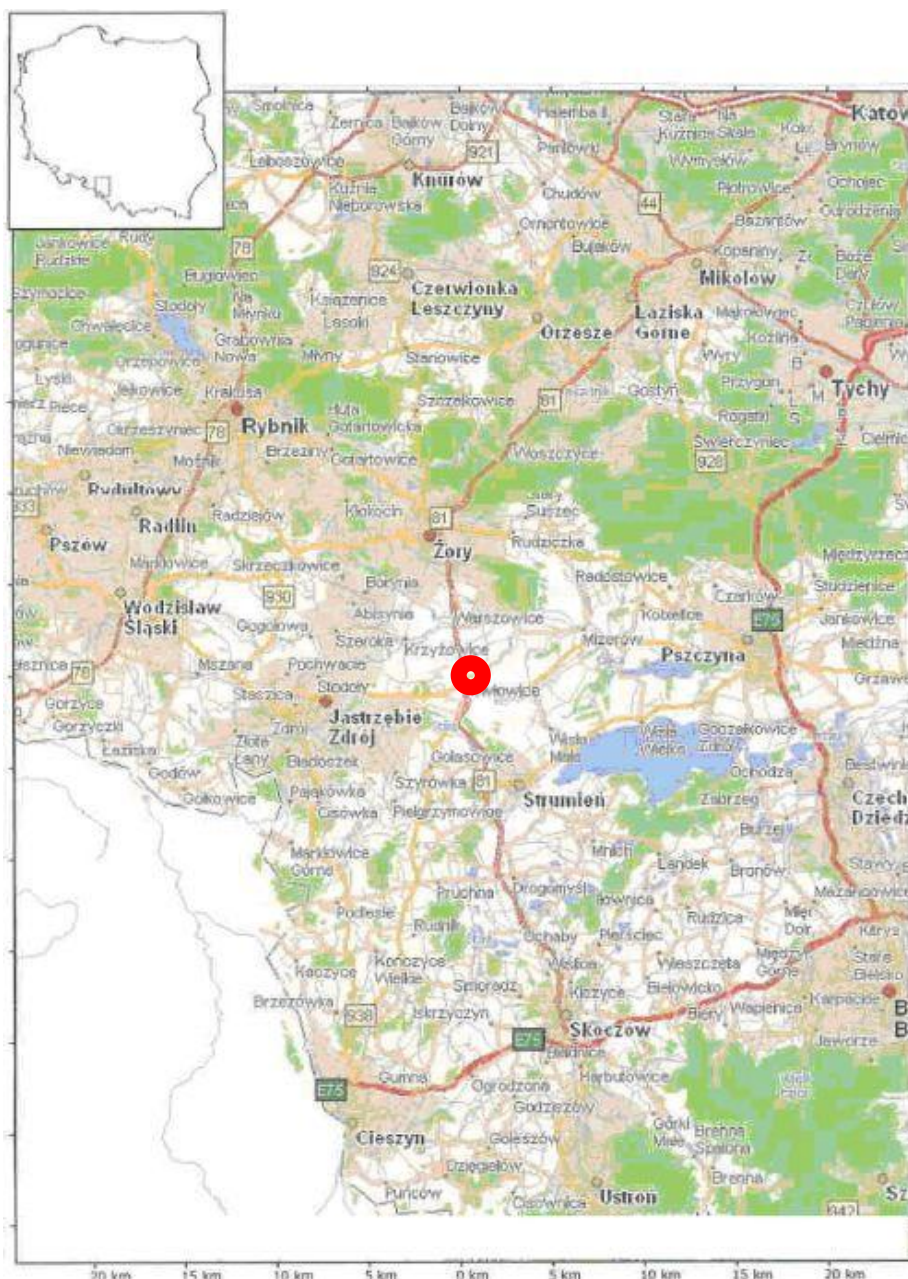


Figure A-3: Location of the Project in Pawłowice

A.4.1.4. Detail of physical location, including information allowing the unique identification of the project (maximum one page):

The project is located at the coal mine "Pniowek" in Upper Silesia.

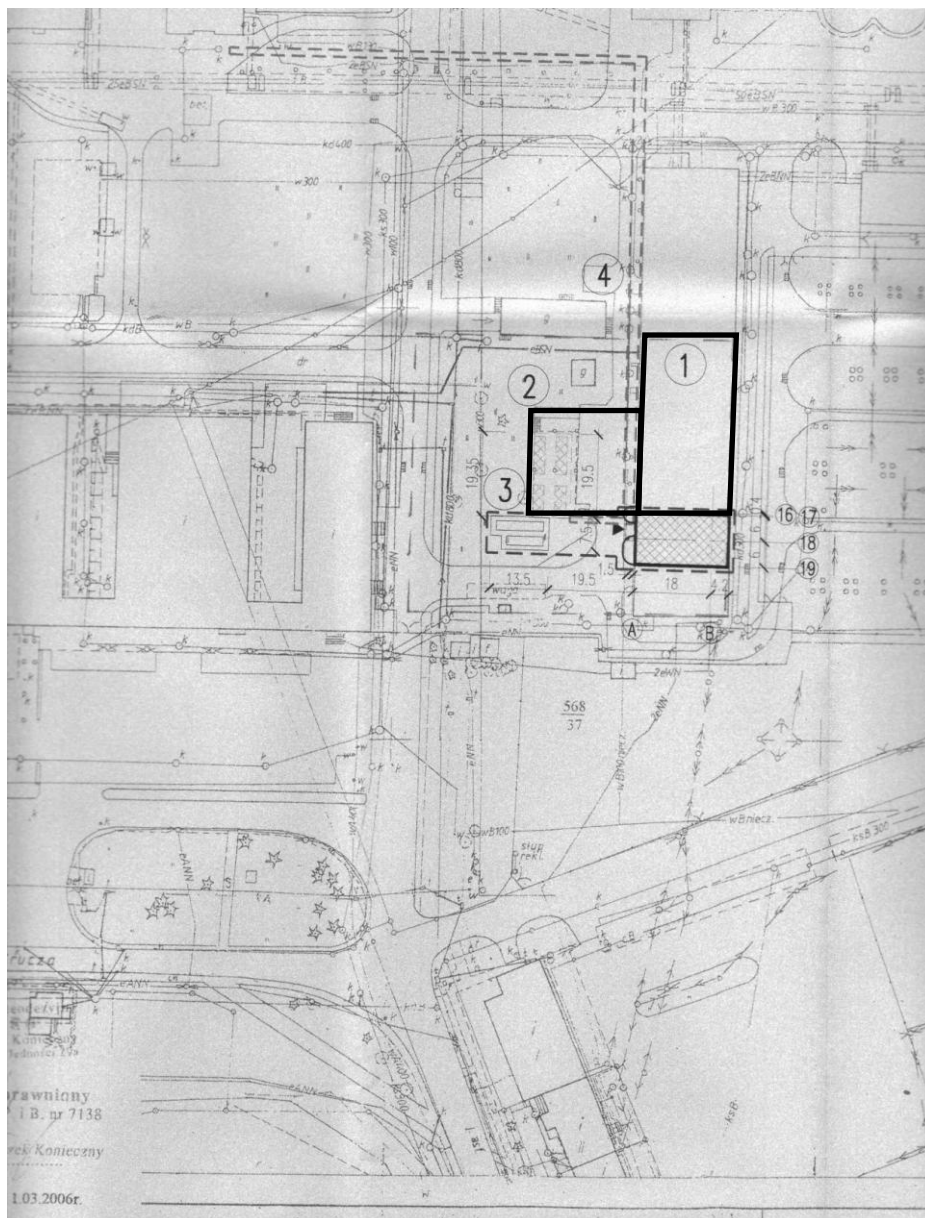

LEGEND

- 1. building with the CHP unit inside
- 2. fan cooler
- 3. infrastructure not belonging to the project
- 4. pipeline

Figure A-4: Unit location plan at the coal mine Pniowek
————— Boundary of the project

**A.4.2. Technology(ies) to be employed, or measures, operations or actions to be implemented by the project:****Degasification activities**

The mine has an active degasification system. A part of the CMM is sucked out of underground boreholes in the longwall and the mining area and is collected in a central suction system, which ends on the surface of the venting shaft.

The suction system was primarily designed for operational safety in the underground and not for CMM utilisation and there are no national regulations or legal requirements for treatment and utilisation of the captured CMM. However it is common practice at Polish coal mines to release the CMM into the atmosphere, the coal mine Pniowek used a part of the sucked CMM in old CHP-Units and in boiler systems for heat generation.

Project activities - Utilisation of CMM

In the case of this project a part of the CMM from the suction system is utilised for heat and power generation. This additional part of methane is destroyed by burning. The remaining amount of the CMM should be further on released to the atmosphere unused.

Utilisation of the methane captured (the project)

The utilisation of the CMM is provided through:

1. installation of two cogeneration units for power and heat production for displacement of grid power and heat produced otherwise in coal fired boilers.

The methane flow from the suction system is more than 2500 m³/h. pure methane. The installed plant cannot use whole amount of the gas, a part of it is still unused blown in the atmosphere. The utilisation plan is shown in table A-2.

Table A-2 – Installation plan of the project

unit	installation date	firing capacity (each unit)	product	efficiency
2 cogeneration units Type Deutz TBG 632 V16	2000	8,950 kW 4,058 kW _{th} 3,535 kW _{el}	power and heat	Electrical efficiency 39.5 % Thermal efficiency 45.3% Total efficiency 84.8%



CMM Supply

The utilisation unit is connected to the central suction system. The pressure generated by the vacuum pumps of the coal mine is sufficient to supply the utilisation unit, so that no further compression is needed. The total amount of CMM sent to the utilisation unit is measured by flow meters. The unit is provided with a deflagration flame arrester which prevents backfiring from the utilisation unit into the suction system of the coal mine.

Cogeneration unit

Two cogeneration units with a firing capacity of approx. 8,950 kW each were installed. The cogeneration units generate power with an output of approx. 3,535kW per unit, and hot water for the central heating system of the coal mine with an output of max. 4,058 kW per unit.

The CMM is fed into the gas engine, where the methane will be burned completely with low exhaust emissions. The cogeneration unit is operated fully automatically and all essential measured data are gathered and recorded.

Cogeneration units like this have been tested at various sites in Western Europe and are now approved. Especially in the Ruhr District in Germany a large amount of units (approx. 150) is installed on active and abandoned coal mines.

Proved safety-related equipment is used to minimize the risks of the plant.

Technical data per unit	cogeneration unit for combined heat and power generation installed in an industrial building, including all necessary equipment, control and data collection system
Installed firing capacity	8,950 kWth *
Power output	max. 3,535 kWel *
Heat output	max. 4,085 kWth *
Efficiency (electricity)	max. 39.5 %
Maximum methane amount required	1,010 m ³ /h CH ₄
Average operation time	7500 h/a
Average heat generation	30,000 MWh/a
Average power generation	26,512 MWh/a
Average methane destruction	7,575,000 m ³ CH ₄ per year = 5,431 t CH ₄ per year
Average power own consumption	930 MWh/a

*) firing capacity, efficiency and power and heat output depend on the gas quality, methane concentration and load.

Electricity utilisation

The electricity for the coal mine facilities was purchased from the grid. The electricity generated by the power generator of the CHP installed in the project is now used for the own consumption of the coal



mine. The power will be fed into the grid of the coal mine, which is connected to the Polish grid. In this way the power amount which was purchased from the grid was reduced. This amount of conventionally generated power displaced by the project generates additional emissions reductions which will be taken into account aiming the issuance of ERU.

The cogeneration units and the mine conditioning are actually not economically viable. The installation of the plant was based on an environmentally conscious management decision.

Heat utilisation

The heat supply of the coal mine was provided by coal and partly by CMM boilers. After the project realization a part of this energy was displaced by the heat generation of the project. A part of CMM is co-fired with coal in old boilers. This amount of conventionally generated heat displaced by the project generates additional emissions reductions which will be taken into account aiming the issuance of ERU.

Maintenance program

The maintenance and operation of the project equipment is provided by the personnel of the plant operator (SEJ). The maintenance of the CHP modules has been carried out by the service division of the engine manufacturer.

Risks of the project

The following risk could be identified:

Table A- 3: Risk and mitigation to the project

Risk	Mitigation
Lower CMM utilisation than expected	The amount of extracted CMM is normally higher than the amount of utilised CMM. The amount of CMM is expected to increase in the future, due to the extension of the coal mining activities.
Malfunctioning of the CHP plant.	Training of the staff and regular maintenance of equipment.
Lower concentration of methane in extracted gas	The supporting systems regulate automatically the amount of gas that is combusted in the CHP unit. Despite that a minimum concentration of 30% CH ₄ is required.

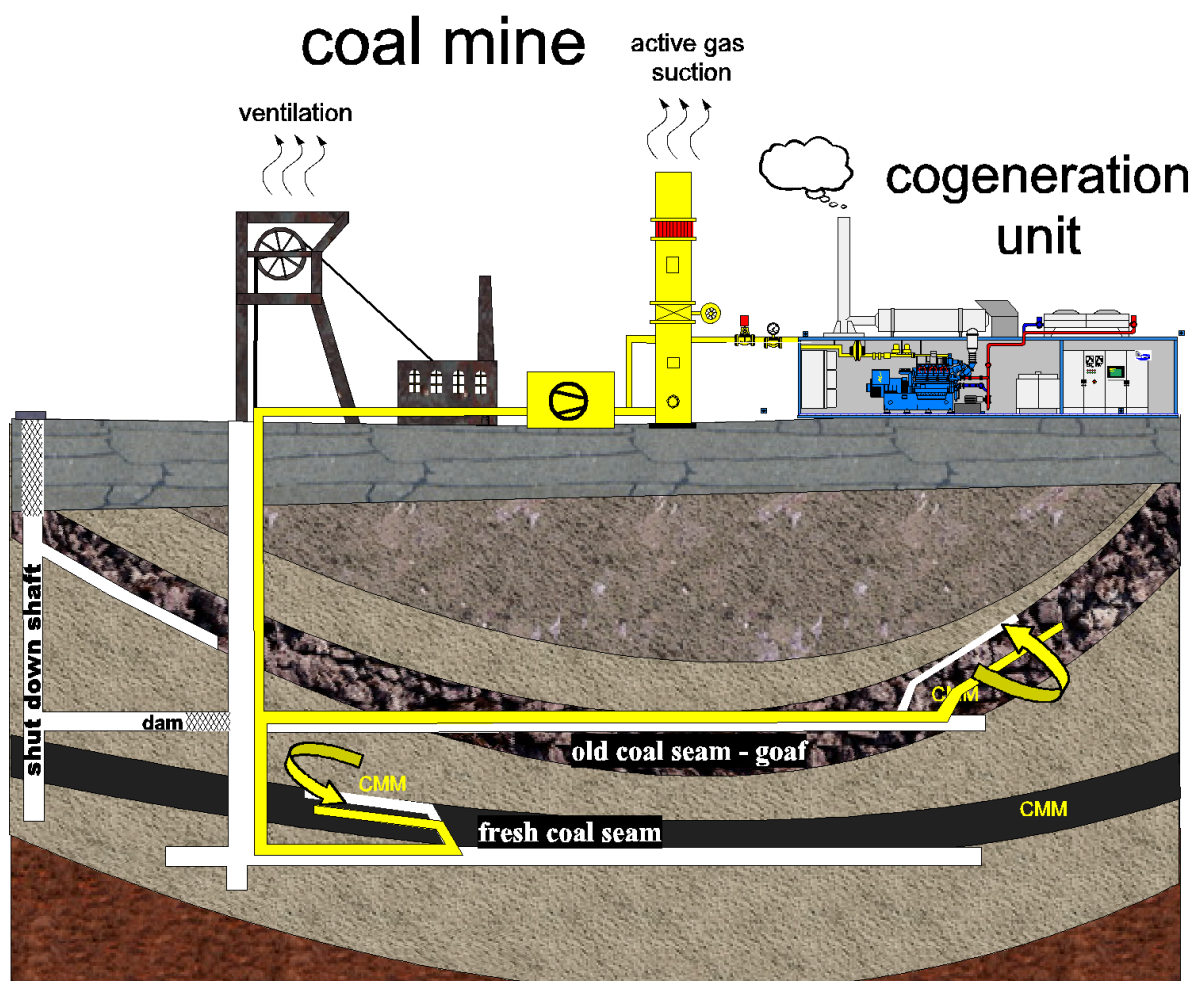


Figure A- 6: Scheme of the installation with main project components

A.4.3. Brief explanation of how the anthropogenic emissions of greenhouse gases by sources are to be reduced by the proposed JI project, including why the emission reductions would not occur in the absence of the proposed project, taking into account national and/or sectoral policies and circumstances:

The emissions reduction is based on the displacement of power and heat production by means of using CMM in combustion processes of a gas engines. In absence of the project the whole heat and power amount generated in the units would otherwise be produced from fossil fuels causing much higher CO₂ emissions.

The power generated by the project displaces conventionally generated power and reduces the greenhouse gas emissions of the Polish grid.

The heat generated by the project displaces conventionally generated heat by coal combustion and reduces the greenhouse gas emissions of the coal mine.



The project is not "business-as-usual" and faces several barriers, both in terms of prevailing practice and the economic attractiveness of the project. In section B of this PDD, it is shown that the emission reductions would not occur in absence of the project.

A.4.3.1. Estimated amount of emission reductions over the crediting period:

Table A- 4 — *Emission reductions during the crediting period (2008-2012)*

1st Crediting Period 2008- 2012	
	Years
Length of the crediting period	5
2008	43,996
2009	43,996
2010	43,996
2011	43,996
2012	43,996
Total estimated emission reductions over the <u>crediting period</u> (tonnes of CO ₂ equivalent)	219,979
Annual average of estimated emission reductions over the <u>crediting period</u> (tonnes of CO ₂ equivalent)	43,996

There are no special conditions for small scale projects defined by the host party. The following information is given for the purpose of the project registration.

According to the data given above the project falls under:

Type III of JI SSC projects (Other projects that result in emission reductions of less than or equal to 60 kilotonnes (kt) of carbon dioxide (CO₂) equivalent annually) as defined in "Provisions for joint implementation small-scale projects" developed by the JISC

The proposed JI SSC project is not a debundled component of a large project as there is no a JI (SSC) project with a publicly available determination in accordance with paragraph 34 of the JI guidelines:

- (a) Which has the same project participants; and
- (b) Which applies the same technology/measure and pertains to the same project category; and
- (c) Whose determination has been made publicly available in accordance with paragraph 34 of the JI guidelines within the previous 2 years; and
- (d) Whose project boundary is within 1 km of the project boundary of the proposed JI SSC project at the closest point.



The emission reduction for the period beyond 2012 is not possible according the regulations valid at the time of determination. But the crediting period can extend beyond 2012 subject to the approval by the host party. The information on the possible emission reductions for this period is given on completion.

Table A- 5 — *Emission reductions during the second crediting period (2013-2017)*

Crediting Period 2013- 2017	
	Years
Length of the crediting period	5
2013	43,996
2014	43,996
2015	43,996
2016	43,996
2017	43,996
Total estimated emission reductions over the <u>crediting period</u> (tonnes of CO2 equivalent)	219,979
Annual average of estimated emission reductions over the <u>crediting period</u> (tonnes of CO2 equivalent)	43,996
Total estimated emission reductions over the <u>expected project life-time 2000-2017</u> (please refer to C.2 (tonnes of CO2 equivalent)	747,929

A.5. Project approval by the Parties involved:

The parties involved will support the project. The great impact for reduction of greenhouse gas is one motivation to drive the system.

The letter of approval of the Netherlands as of the investor country was issued 2012, June 15th (Reference: 2011JI51) .

The PDD is a part of a request for the Letter of Approval by Poland within the first track according to the current Polish Act of 17 July 2009 on the System to Manage the Emissions of Greenhouse Gases and Other Substances.

The project aims only the emission reduction units from the power and heat displacement which is now possible after the most recent Polish law adopted on 28th April 2011 which results also in changes of the abovementioned act.

After the Law from 28.04.2011 it is not mandatory to request for a Letter of Endorsement for projects aiming emission reduction through displacement of energy production from fossil fuels. The project presented for approval

- must be additional
- must not cause deterioration of the environmental quality;
- must ensure the limitation of adverse environmental impacts;



- must implement the criteria on BAT
- and be a project belonging to types of projects which can be carried out as Joint Implementation projects in the territory of the Republic of Poland according to the most recent regulation.

The Polish regulation from 26 August 2010 (Dz.U. 2010, nr 167 poz. 1132) about the kind of projects eligible to be approved as JI in Poland specifies projects aiming the emission reduction or avoidance within the energy generation by means of change of fuels used or change of technology applied. The project uses methane as a waste gas which would be otherwise released into the atmosphere instead of fossil fuels in the Polish energy production. There was also a technology applied which allows the use of this fuel instead of the coal fired steam boiler and turbine sets applied widely in the Polish sector. The changes allow to displace the energy produced by conventional methods using fossil fuels and to avoid emissions caused in the conventional processes.

Furthermore, even if not claiming the emission reduction from methane destruction the project leads to significant reduction of methane emission from mining.

Hence the presented project belongs to projects eligible to be approved as JI.

In addition to that the project must be implemented before 28th February 2012.

The project meets all these requirements for approval by the host party.

According to the most recent JI guidance of the unfccc projects starting as of the year 2000 may be eligible as Article 6 projects if they meet the requirements of the guidelines for the implementation of Article 6 of the Kyoto Protocol and that emission reduction units shall only be issued for a crediting period starting after the beginning of the year 2008.

SECTION B. Baseline

B.1. Description and justification of the baseline chosen:

The JI specific approach for baseline setting and monitoring has been used to identify the baseline scenario of the proposed JI project. According to the most recent guidelines for baseline setting and monitoring (JISC18) elements of approved CDM baseline and monitoring methodologies or approved CDM methodological tools can be used, as appropriate.

Furthermore some elements of the approved consolidated methodology ACM0008 / Version 07 "Consolidated baseline methodology for coal bed methane and coal mine methane capture and use for power (electrical or motive) and heat and/or destruction by flaring") has been used to identify the baseline scenario of the proposed JI project [ACM0008] was used.

Applicability of ACM0008 for the baseline scenario

The project involves the extraction of CMM from

- underground boreholes in the mine to capture pre mining CMM



- underground boreholes, gas drainage galleries and other goaf capture techniques, including gas from sealed areas to capture post mining CMM.

The extraction activities mentioned above are listed as applicable project activities.

The methane is to capture and to destroy

- through utilisation to produce electricity and thermal energy. Emission reductions for displacing energy from other sources (mainly coal for heat and power generation) are not claimed.

Ex-ante projections have been made for methane extraction and utilisation. The CMM is captured through existing mining activities. The following steps apply to an active coal mine.

The project activity has none of the following features:

- The mine is not an open cast mine
- The mine is not an abandoned/decommissioned coal mine
- There is no capture of virgin coal-bed methane
- There is no usage of CO₂ or any other fluid/gas to enhance CMM drainage. In step 1 below the method of extraction is described in more detail

Hence ACM0008 is applicable to this project.



Step 1. Identification of technically feasible options for capturing and/or using CBM or CMM

Step 1a. Options for extraction

According to the ACM0008 methodology, all technically feasible options to extract CMM have to be listed. In Polish coal mines CMM has to be captured from seams with high methane content. The classification is given in the according Polish regulation /CMM-Reg/. The pre mining CMM captured can be collected in the CMM gas system or diluted into the ventilation shaft.

The post mining CMM can also be captured according to the regulation. The design of the possibly post mining CMM capture is each time adapted to the given situation in the mine.

CMM deliberating to the working area of the mine has to be vented in an adequate way. The maximal concentration of the methane in the ventilation shaft should not become higher as 0.75% at every time.

An utilisation of CMM is not required by the Polish law.

A.1 Pre mining CMM captured by underground boreholes

A.2 Pre mining CMM captured by surface drainage wells

B.1 Post mining CMM captured by underground boreholes

B.2 Post mining CMM captured by surface drainage wells

C Possible combinations of options A, B, and C, with the relative shares of gas specified.

A big amount of the methane on the project site is currently released to the atmosphere together with the ventilation air – option A. In this case it is not the methane captured, but only this part which deliberates from the coal seam directly in the venting air. Due to the low concentration of methane in the ventilation air (usually less then 0.75%), this methane cannot be utilised. So that the ventilation air methane is not considered in the PDD.

In the case of the project there are no existing surface drainage wells and no wells are planned, so that the options A2 and B2 are not technically feasible.

In the case of the project pre mining CMM and post mining CMM from underground boreholes is collected together in one central suction system and transported to the surface with vacuum pumps. There is no dilution of the captured CMM into the venting shaft. It is impossible to determine the shares of the sources, because numerous drainage branches are connected to the central system and every branch collects CMM as long as it is in operation. So that in the case of the project the option C is the only option that is technically feasible for utilisation purposes. Usually the concentration of methane in the extracted gas ranges from 30-70%.

A big amount of the methane on the project site is currently released to the atmosphere together with the ventilation air. In this case it is not the methane captured, but only this part which deliberates from the coal seam directly in the venting air. Due to the low concentration of methane in the ventilation air



(usually less than 0.75%), due to lacking of technical possibilities, this methane is not utilised or planned to be utilised at the project location. The ventilation air methane is hence not considered in the PDD.

The degassing system was implemented for safety reasons, due to fulfil the according regulations. It would have been also implemented without the proposed project activity.

Step 1b. Options for extracted CBM and CMM treatment

Several approaches can be taken to treat the captured CMM of the project:

- i. Venting
- ii. Using/destroying ventilation air methane rather than venting it
- iii. Flaring of CMM
- iv. Use for additional grid power generation
- v. Use for additional captive power generation
- vi. Use for additional heat generation
- vii. Feed into gas pipeline (to be used as fuel for vehicles or heat/power generation)
- viii. Possible combinations of options i to vii with the relative shares of gas treated under each option specified

All of these options are considered as possible alternatives for the baseline scenario. In step 3 of this section some of these options will be further developed into baseline scenario alternatives. The project activity is covered by the option viii. – the combination of option vi. heat generation, and option v. captive power production.

Step 1c. Options for energy production

The options for energy production are included in the options iv. to viii. listed in step 1b.

The project activity is covered by the option viii. – the combination of option vi. heat generation, option iv Use for additional grid power generation and option v. captive power production.

Step 2. Eliminate baseline options that do not comply with legal or regulatory requirements

According to the national safety regulations, the coal mine methane has to be extracted. There is no regulation in place that would require any specific utilisation of the extracted methane. On the other hand, there is no national regulation in place that would prohibit any use of CMM, e.g. for heat and/or electricity generation. Therefore, all the alternatives listed in step 1b are in compliance with the existing regulations.

Step 3. Formulation of the baseline scenario alternatives

The following alternatives can be considered for implementation at the project site and are in compliance with the options listed in step 1b and step 1c. In any case the coal mine has to extract the CMM from the



mine for safety reasons. Therefore the alternatives below assume extraction as described in step 1a and describe in detail the alternatives for treatment and utilisation.

Alternative i. - Venting of CMM

Since there are no legal requirements for treatment and utilisation of the captured CMM, it is common practice at Polish coal mines to release the CMM into the atmosphere. This alternative is the actual situation before project implementation – the part of the CMM extracted by the project was released into the atmosphere.

The energy demand and supply of the coal mine in this scenario would continue in the following way:

- Electricity would be supplied by the national/regional grid
- On-site heat demand would be supplied by the coal fired and partly CMM fired on-site boilers

Alternative ii. Using/destroying ventilation air methane rather than venting it

This alternative is not technical feasible, neither the use nor the destruction, due to the low concentration of the methane in the ventilation air. The mentioned amount of CMM vented is not understood as VAM, but the CMM with higher methane content, captured for safety reasons in the underground, exhausted in the atmosphere without utilisation independent from VAM.

The energy needs of the mine will be supplied in the same way as described in alternative i.

Alternative iii. Flaring of CMM

The flaring of the captured methane is not required by any existing national regulations. The infrastructure for methane flaring does not exist at the coal mine, so that additional investment would be required. Without revenues from emissions trading this alternative would only generate costs and is economically not viable.

The energy needs of the mine would be supplied in the same way as described in alternative i. A flaring of CMM is in discussion to destroy of the remaining CMM of the mine and a part of the project scenario.

Alternative iv. – use for additional grid power generation

The captured methane could be utilised in a power plant for power generation. Possible power plant alternatives are:

- a) conventional steam power plant, CMM fired
- b) combined gas-steam power plant, CMM fired
- c) gas turbine, CMM fired
- d) gas engine, CMM fired
- e) fuel cell, CMM fired

The energy needs of the mine would be supplied in the same way as described in alternative i.

*Alternative v. – use for additional captive power generation*

The captured methane could be utilised for captive power generation. A combined heat and power generation is possible and eligible:

- a) cogeneration unit, CMM fired

The captive power generation with CHP units is part of the project scenario. See alternative viii.

Alternative vi. – use for additional heat generation

The captured methane could be utilised for additional heat generation, that means heat, which should be used outside the coal mine facilities. The existing boilers of the coal mine are supposed to supply only the coal mine facilities, the existing heating system is not connected to any other heating system outside the coal mine. So in this case a new heat generation plant should be constructed and connected to a heating system outside the coal mine, e.g. a district heating system. Possible heat generation plant alternatives are:

- a) conventional steam boiler, CMM fired
- b) conventional hot water boiler, CMM fired or co-fired
- c) heat generation in the cogeneration unit

The energy needs of the mine would be supplied in the same way as described in alternative i.

Alternative vii. – feed into a gas pipeline (to be used as fuel vehicles or heat /power generation)

There are three possible ways to utilise the captured methane:

- a) feeding into a gas pipeline – in this case a new connection to an existing pipeline has to be made. Depending on the quality specification of the pipeline operator, most likely an additionally methane enrichment plant could be required
- b) compression of the gas and usage as fuel for vehicles
- c) liquefaction of the gas and transportation in tanks for utilisation by external users

The energy needs of the mine would be supplied in the same way as described in alternative i.

Alternative viii. – possible combinations of alternatives i. to vii.

There are numerous possible combinations of the alternatives i. to vii. described above, so that only the project scenario should be described in the following.

The CMM should be utilised for heat and captive power generation. All produced heat and power should be consummated by the coal mine. The remaining amount of the CMM which cannot be utilised for heat and power generation (especially in the summer) should be exhausted in the first step. If the amounts of remaining CMM are big enough, they will be burned in a flare with a suitable firing capacity.

There is a CHP system for power production implemented as a project activity.

Power is produced by the cogeneration unit. The remaining required power amount required by the mine should further be delivered from the grid.



The remaining available CMM amount, which cannot be utilised for heat and power production is being exhausted now.

Step 4. Elimination of baseline scenario alternatives that face prohibitive barriers

In this section the possible alternatives formulated above will be checked against the existing economic and other barriers for their implementation. Non-realistic alternatives will be eliminated.

Alternative i. Venting

The existing national regulations require that captured CMM has to be vented for safety reasons. There are no legal requirements that prohibit venting or require mines to utilise CMM. This alternative represents the current situation in the absence of the proposed project activity. There are no barriers or external factors that prevent this alternative to be continued. Therefore, this scenario can be considered to be a realistic alternative.

Alternative ii. Using/destroying ventilation air methane rather than venting it

As already mentioned under step 3, this alternative is not technically feasible at the present time, neither the use nor the destruction, due to the low concentration of the methane in the ventilation air. The VAM cannot be burned stand alone. A use of VAM as support for the combustion air requires an existing appropriate technological process at the project site, which does not exist. Other technological solutions were only implemented as demonstration, if at all.

Therefore this alternative faces a prohibitive barrier.

Alternative iii. Flaring of CMM

Flaring of CMM is not required by the existing national regulation. Additional investment has to be made by the project owners to install the flare. The operation would generate additional costs without revenues from emissions trading no income but only costs are generated, this alternative is therefore economically not viable.

So this scenario is facing a strong prohibitive barrier, because the investment would not generate any revenues.

Alternative iv. Use for additional grid power generation

Generally CMM can be used for electricity generation that is delivered to the grid.

a) conventional steam power plant, CMM fired

The mine cannot guarantee a stable minimum amount of CMM needed for a conventional steam power plant. It could be only possible by means of additional amounts of captured CMM. /Gat-1994/ Usually power generation in conventional steam power plants is economically viable for middle and large scale plants (more than 20 MWel), so in case of the project the alternatives b) to e), which are listed below, be economically more attractive.

Therefore this alternative faces a prohibitive barrier and is eliminated.



b) combined gas-steam power plant, CMM fired

A combined gas-steam power plant is a rather new technology. At present the technology is only available for natural gas, so that the CMM, which has an appreciable lower methane concentration and lower calorific value, should be first conditioned to an adequate quality. The additionally required conditioning plant makes this alternative economically not viable.

Also a stable minimum amount of CMM needed for combined gas-steam power plant cannot be guaranteed. There is also no need for a additional heat amount produced by the plant /Gat-1994/

Therefore this alternative faces multiple prohibitive barriers and is eliminated.

c) gas turbine, CMM fired

At present this technology is only available for gases with high caloric values, so that the CMM, which has a low calorific value, should be first conditioned to an adequate quality. The additionally required conditioning plant makes this alternative economically not viable. There is also no experience in Poland with such technologies for CMM utilisation, it would be therefore a solution first in its kind, which is a clear barrier according to ACM0008

Therefore this alternative faces some prohibitive barriers and is eliminated.

d) gas engine, CMM fired

This alternative is the most suitable technology for power generation in the prospected range of performance. In this alternative only power generation for the grid and no heat generation is regarded.

This alternative is not economically viable, because the required revenues for the power feed-in into the grid are not marketable due to the business competition of the grid owners. The actually achievable sale price of power is too low. There were no privileges for power produced from CMM according to the Polish Energy Law valid at the time of investment decision and the sale price realisable at the project start was too low too. There is since autumn 2010 a possibility to get tradable certificates for power generated in cogeneration which could not be taken into account at the time of investment decision for the project activity.

Therefore this alternative faces a prohibitive barrier and is eliminated.

However this alternative is more suitable for captive energy generation in the project scenario, especially by the combined heat and power generation in cogeneration units, see alternatives v. and viii.

e) fuel cell, CMM fired

At present this technology is only available for gases with high caloric values, so that the CMM, which has a low calorific value due to low methane concentration, should be first conditioned to an adequate quality. The additionally required conditioning plant makes this alternative economically not viable. Further on this would be the first fuel cell fired with CMM in Poland and there are no skilled and properly trained personnel for the operation and maintenance of this kind of technology.

Therefore this alternative faces multiple prohibitive barriers and is eliminated.

*Alternative v. Use for additional captive power generation*

The captive power generation is part of the project scenario.

Although this technology is the most suitable technology for power generation for captive energy generation in the project scenario, especially by the combined heat and power generation in cogeneration units, this alternative requires high investment. Also the operating and the maintenance costs of the new technology are high. On the other hand the specific energy costs of the coal mine and the electricity price in Poland are at the time too low for economically justifiable power generation in cogeneration units.

The very high investment of the project made it not economical viable¹. All incentives from the heat and power production were the first 3-5 years spent for repayment of the bank loan and other services.

It makes visibly, that the alternative faces prohibitive barriers and is eliminated as a baseline scenario. See alternative viii.

Alternative vi. Use for additional heat generation

The low investment possibilities as upgrade of the existing systems for utilisation of CMM for heat generation are exhausted¹. The heat demand is to be met before all other users and in the case of Polish mines, and so at the project site.

The project operator operates three boiler systems co-fired with CMM, with a suitable heat production for the needs of the regarding facilities. The heaters work mainly fired with coal due to meet the heat requirements of the mine. Furthermore they work on seasonal demand. The use of CMM for co-firing is quite problematic and meets not the environmental requirements. Due to handling problems the boilers co-fired with CMM would be decommissioned in the future. The heat demand of the facilities decreases furthermore. The installed systems cover the heat needs, so that an additional heater is not necessary.

A conventional steam boiler produces steam, so that a steam grid is required for the transportation of the generated heat to the users. Because no such a grid is available and the investment and maintenance cost for such a grid are too high the alternative is not implementable.

A conventional hot water boiler produces hot water, which is supposed for use on the mine. This alternative requires a redesign of the conventional boiler for the possible operating with CMM, with coal and for co-firing. On the other hand the specific energy costs of the coal mine are low and cannot ensure a economically justifiable heat system based only on CMM.

A conventional hot water boiler produces hot water, which is supposed for the feed-in in a heating grid, e.g. a district heating system. As the district heating is not the common solution for the sparsely populated region where the mine is located and the next really available district heating system is too far away, the connection would cause very too high investment costs to make this alternative economically viable.

The alternatives face prohibitive barriers and are eliminated.

¹ Tor, Gatnar, DRAINAGE AND ECONOMICAL UTILIZATION OF METHANE-GAS FROM COAL SEAMS IN THE MINING FIELD JASTRZĘBIE COAL COMPANY IN COGENERATION POWER SYSTEM, Proceedings of International Scientific Conference "Geothermal Energy in Underground Mines" November 21-23, 2001, Ustroń, Poland

*Alternative vii. feed into a gas pipeline (to be used as fuel vehicles or heat /power generation)*

There are three possible ways to utilise the captured methane:

a) feeding into a gas pipeline

In this case a new connection to an existing gas pipeline has to be made. Also an additionally methane enrichment plant is required to fulfil the quality specification of the pipeline operator. The costs of the enrichment plant and the lacking piping infrastructure make this alternative economically not viable. Further on the alternative faces a barrier due to the absence of prevailing practises to feeding into a gas pipeline of natural gas.

Therefore this alternative faces a prohibitive barrier and is eliminated.

b) compression of the gas and usage as fuel for vehicles

This alternative requires a suitable large fleet of vehicles, which are upgraded with CMM compatible engines. But there are not enough such consumers available. Further on the alternative faces a barrier due to the absence of prevailing practises to utilise CMM as vehicle fuel.

Therefore this alternative faces prohibitive barriers and is eliminated.

c) liquefaction of the gas and transportation in tanks for utilisation by external users

This alternative requires a liquefaction plant. The required investment for the plant is high. There is significant uncertainty in Poland on the domestic price of natural gas, and as a consequence, on the economic feasibility of such a project. There are no personnel available, which is skilled and properly trained for the operation and maintenance of such a plant. Further on the alternative faces a barrier due to the absence of prevailing practises to utilise CMM for liquefaction purposes.

Therefore this alternative faces prohibitive barriers and is eliminated.

*Alternative viii. Possible combinations of options i to vii with the relative shares of gas treated under each option specified.
This alternative describes the project scenario not registered as JI-Project*

A combination of the alternatives described above faces similar barriers as the alternatives as standalone solutions. The most probably combination would be the project scenario not registered as JI, where 100% of treated methane would be used for.

The project scenario alternative as described in step 3. requires a high investment, the operating and the maintenance costs of the new technology are relatively high, on the other hand the specific energy costs of the coal mine are relatively low. The electricity price in Poland is at the time too low for economically justifiable power generation in cogeneration units. As shown in the calculation of profitability, the project scenario is financially not attractive. This is proven in section B.2 of this PDD.

The reduction of methane emissions was a reason for the plant start-up and was so made public in the scientific papers and conferences. Financial advantages from emission reduction were seriously



considered in the decision to proceed with the project activity.^{1, 2} Before the start of project works an analysis of the environmental effects was made³.

In addition there is significant uncertainty in Poland on the domestic price of natural gas, and as a consequence, on the economic feasibility of such a project. Project finance in Poland is absent as shown in section B.2 and therefore the investment would have to be paid from the cash flow of the project operator.

Thus this alternative is a realistic alternative but faces economic barriers and is eliminated.

Conclusion

There is only one realistic option for the baseline scenario, which is the continuation of the current situation: venting of the CMM into the atmosphere.

The heat demand of the mine would be met by production from coal fired boilers. The electricity would be purchased from the grid.

The low investment possibilities for use of methane were not possible to implement anymore, due to lacking heat demand on site. The cold water demand would be met by the existing system. As mentioned by the operator solutions requiring high investment were not economical viable for the company. The proposed technological solution was first of its kind and therefore there was also a strong barrier due to missing experience and technological requirements. The solution was a part of the company's strategy for reduction of methane emissions and as such considered in the management decision concerning the investment and communicated in scientific papers.

Without any additional income from emission trading, the project is economically not viable and faces prohibitive barriers.

² Nawrat, S., Gatnar, K., Drainage and economical utilization of methane from seams in the mining field of Jastrzebie Coal Company, in proceedings of International Conference on Coal-Bed Methane- technologies of recovery and utilisation, Katowice, 1998

³ Barteczko, B., Nawrat, S. Rzepski, H., Schöler, J., Klimatisierung unter Tage (Underground air conditioning), Brennstoff-Wärme-Kraft ISSN 0006-9612 2001, vol. 53, no1-2, pp. 45-50

**B.2. Description of how the anthropogenic emissions of greenhouse gases by sources are reduced below those that would have occurred in the absence of the JI project:**

In accordance with the methodology, additionality has to be proven by applying the "Tool for demonstration and assessment of additionality", (version 06.1.0), EB69.

The result is given below.

Step 1. Alternatives

In accordance with the methodology ACM0008, this step is ignored.

Step 2. Investment analysis

In this step is to determine whether the proposed project activity is not

a) the most economically or financially attractive

or

b) economically or financially feasible, without the revenues from the sale of ERUs

Sub-step 2a. Determination of the analysis method

The proposed project activity generates also other revenues than only those from JI. Therefore, simple cost analysis (Option I) is not applicable.

Obtaining financial indicators for similar projects in Poland is problematic as this project is one of the first in its kind and each of existing projects has another constellation; therefore the investment comparison analysis (Option II) cannot be performed for the identified alternatives and the benchmark analysis (Option III) will be used to test the additionality of the proposed emission reduction project activity.

Sub-step 2b. Application of the benchmark analysis

The project operator (SEJ) can only sell the produced energy, if it is cheaper than that from the grid. The project operator buys the CMM and sales the electricity and heat under that given conditions. The project operating company must evaluate a project, which is economically viable. Project IRR is chosen as the benchmark of the proposed activity. According to the "Guidelines on the assessment of investment analysis" (Ver. 05, EB 62) local commercial lending rates or weighted average costs of capital (WACC) are appropriate benchmarks. The average commercial lending rate in the year 2000 was 20%.

Sub-step 2c. Calculation and comparison of the indicators

The economic indicators for the proposed project without JI revenue has been calculated under the following assumptions:

Supposed prices for electricity and heat were taken as of 2000, after the decision to implement the project was taken.



The project has the following economic indicators:

Table B-1: Economic indicators of the project, with and without revenues from emissions trading

Option	IRR	
Economic Parameters without ERUs	12.98	%
Economic Parameters with ERUs	14.10	%

Sub-step 2d. Sensitivity analysis

A sensitivity analysis of the proposed project was made based on the market data available at the moment of making the financial analysis of the proposed project. The price for the electricity sold to the mine should be approximately 5-10% lower, than the electricity from the grid. According to the "Tool for the demonstration and assessment of additionality", the revenues from electricity and heat sale in 2000 was supposed changed 10% downwards and 10% upwards as they are the source of revenue. The specific operational costs are those for CMM purchase and maintenance, which are nearly stable, so a variation for the sensitive analysis is not realistic.

Table B-2: Sensitivity analysis of economic indicators of the project, without ERU

Economic Parameters without ERUs	power+heat up 10%	power+heat down 10%	
IRR	16.06	9.45	%

Even in the case of a significant change in the power and heat revenues, the IRR of the proposed project would be lower as the benchmark of 20% for the cost of capital.

Detailed information about the finance indicators and structure of the project finance is given in the Annex 6

Outcome of the step 2 :

Even in the case of a significant change in the power and heat revenues, the IRR of the proposed project would be lower as the benchmark of 20% for the cost of capital. The proposed project is unlikely to be financially attractive.

Step 3. Barrier analysis

Sub-step 3a. Barrier identification

The proposed JI activity faces the following barriers:

Barriers to prevailing practices

According to publicly available information from Polish Ministry of Environment and Polish State Institute of Geology about 442 million cubic meters of CMM were 2005 extracted through degasification systems by Polish coal mines. Confidential statistics are not available. The CHP unit put into operation 1998 at Krupinski caused technical problems and due to high service costs was not economically viable.



The methane utilisation activities of the project operator were since 1998 discussed with focus on the possible emission reduction. The implementation of the activity as an emission reduction project was seriously considered in the decision. The environmental effect as the aim of the project was made public in the international press.

The project is a first of its kind activity according to the “Tool for the demonstration and assessment of additionality” (Version 06.1.0) EB 69 as there is no other examples within the applicable geographical area (Poland) delivering the same output within the calculated output range between 7,593 and 22,779 kW which the same

- (a) Energy source/fuel;
- (b) Feed stock;
- (c) Size of installation (power capacity):
 - (i) Micro (as defined in paragraph 24 of Decision 2/CMP.5 and paragraph 39 of Decision 3/CMP.6);
 - (ii) Small (as defined in paragraph 28 of Decision 1/CMP.2);
 - (iii) Large

Furthermore as concluded after the barrier analysis there is an alternative remaining and it is not the proposed activity without JI, which proves the barrier due to prevailing practice

Technology barrier

The project is a first of its kind activity according to the “Tool for the demonstration and assessment of additionality” (Version 06.1.0) EB 69 and one of the first CMM utilisation projects by means of CHP units Poland. CMM has varying quality and its combustion is not that simple as this of natural gas, it is reflected in the high service demand of the engines. There was only one engine fuelled with CMM installed in Poland and it caused some technical problems. There was also nearly no experiences done in another European countries. It was expected that the maintenance of this technology would be very cost intensive. Therefore there is a clear technology barrier for the realisation of the proposed project. The design of the mine cooling enhancement based on the heat in order to save power is a solution which is unique in Europe till present. The use of heat from the CHP unit displaces the heat from the installed heating facilities.

Financial barrier

See step 2c.

Sub-step 3b. Influence of the barriers identified on the alternative baseline scenario

The only viable alternative to the proposed activity was the continuation of the former situation. Since this scenario does not require any additional investment or changes in the technology, it is not affected by the barriers described above.

**Step 4. Common practice analysis**

Venting the captured CMM into the atmosphere is the common practice in the coal sector of Poland. The project is an activity first of its kind according to “Tool for the demonstration and assessment of additionality” (Version 06.1.0) EB 69 and so **not a common practice**.

The proposed activity is not a common practice and a first of its kind.

Conclusion

The impact of approval of the proposed project activity will allow the crossing of the financial hurdles and other barriers that otherwise would prevent the project from being implemented. The project is additional.

**B.3. Description of how the definition of the project boundary is applied to the project:****Baseline**

The baseline shall be established in accordance with the appendix B of the Guidance on criteria for baseline setting and monitoring.

Table B-4: Overview on emissions sources included in or excluded from the project boundary

Source	Gas		Justification / Explanation
Emissions of methane as a result of venting	CH ₄	Excluded	The amount of methane to be released depends on the amount of coal produced. The baseline scenario for the project activity not implemented as a JI project is taken into account. The emissions associated with methane are not taken under account for the purpose of the project.
Emissions from destruction of methane in the baseline	CO ₂	Excluded	There are no systems for heat and power in the applicable baseline scenario. The amount of emission reduction is not taken under account for the purpose of the project.
	CH ₄	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.
	N ₂ O	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.
Grid electricity generation (electricity provided to the grid)	CO ₂	Included	CO ₂ emissions associated to the same quantity of electricity than electricity generated, as a result of the use of methane are included. In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.
	CH ₄	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.
	N ₂ O	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.
Captive power and/or heat, and vehicle fuel use	CO ₂	Included	In the baseline scenario heat would be generated by the on-site coal boilers. CO ₂ emissions associated to the same quantity of heat than heat generated, as a result of the use of methane are included. In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the



			appropriate set-aside in the national allocation plan.
	CH ₄	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.
	N ₂ O	Excluded	Excluded for simplification. This is conservative and in accordance with ACM0008.



Table B-5: Overview on emissions sources included in or excluded from the project boundary

Project activity

Source	Gas		Justification / Explanation
Emissions of methane as a result of continued venting	CH ₄	Excluded	According to ACM008 only the change in CMM emissions release would be taken into account, by monitoring the methane used or destroyed by the project activity. The amounts associated with methane are generally not taken under account for the purpose of the project.
On-site fuel consumption due to the project activity, including transport of the gas	CO ₂	Included	The own electricity consumption of the cogeneration units (cooling fans) is included.
	CO ₂	Excluded	The electricity consumption of the vacuum pumps is not included in the project boundary as they are necessary for the extraction itself and is performed both in the baseline and project scenario.
	CO ₂	Excluded	The electricity consumption of the CHP unit during the down time is not included in the project boundary as it is not significant. ⁴
	CH ₄	Excluded	Excluded for simplification in accordance with ACM0008. This emission source is assumed to be very small.
	N ₂ O	Excluded	Excluded for simplification in accordance with ACM0008. This emission source is assumed to be very small.
Emissions from methane destruction	CO ₂	Included	Emissions from the combustion of methane in the heat and power generation are included.
Emissions from NMHC destruction	CO ₂	Excluded	The emission amounts associated with methane are generally not taken under account for the purpose of the project. Only CO ₂ emissions associated to the same quantity of electricity than electricity generated, as a result of the use of methane are taken under account.
Fugitive emissions of	CH ₄	Excluded	The amounts associated with methane are generally not

⁴ The average per year over the crediting period is less than 1% of the annual average and does not exceed the amount of 2,000 t CO_{2eq}. Reference JISC "Guidance on Criteria for Baseline Setting and Monitoring".



unburned methane			taken under account for the purpose of the project.
Fugitive methane emissions from on-site equipment	CH ₄	Excluded	The amounts associated with methane are generally not taken under account for the purpose of the project.
Fugitive methane emissions from gas supply pipeline or in relation to use in vehicles	CH ₄	Excluded	The amounts associated with methane are generally not taken under account for the purpose of the project.
Accidental methane release	CH ₄	Excluded	The amounts associated with methane are generally not taken under account for the purpose of the project.

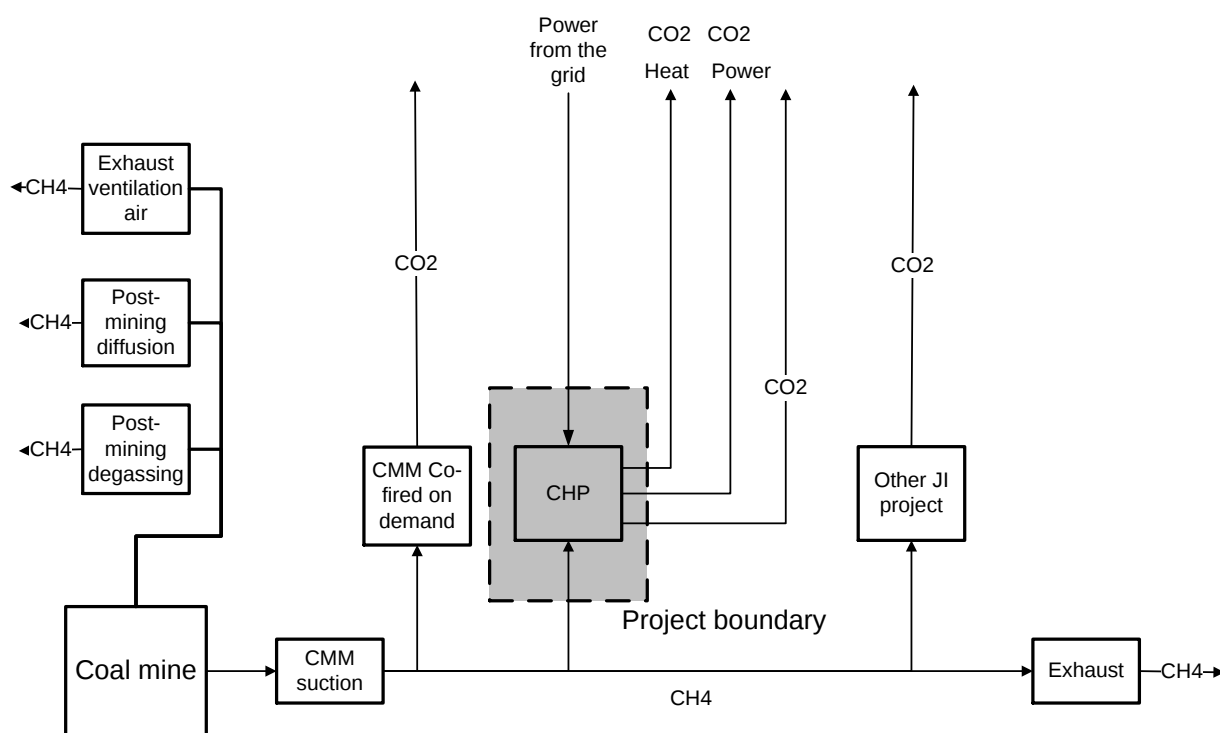


Figure B-3: Project boundary

Overlap of the project activity and the baseline

The amount of captured methane is between ca. 40 up to ca. 58 millions m³ CH₄ per year, as estimated 2000 before the project implementation. The newest forecasts estimated the amount of methane captured in the mine as ca. 55 millions in the years 2008-2012. The systems installed in 1999 could use average 18 millions m³ CH₄ per year.

**Baseline Emissions**

Baseline emissions are given by the following equation

$$BE_y = BE_{MDy} + BE_{MRy} + BE_{Use,y} \quad (1)$$

where

BE_y = baseline emissions in year y (t_{CO_2e})

BE_{MDy} = Baseline emissions from destruction of methane in the baseline in year y (t_{CO_2e})

BE_{MRy} = Baseline emissions from release of methane into atmosphere in year y (t_{CO_2e}) that is avoided by the project activity

$BE_{Use,y}$ = Baseline emissions from the production of power, heat or supply to gas grid replaced by the project activity in year y (t_{CO_2e})

$$BE_{Use,y} = BE_{power,y} + BE_{Heat,y} \quad (2)$$

Methane destruction in the baseline

The project activity uses methane which otherwise would be exhausted into the atmosphere. There is no use of this part of methane in the baseline.

Methane released in the atmosphere

The baseline emissions from release of methane into the atmosphere in the year y ($BE_{MR,y}$) are not taken into account for the project

Leakage

The formula for leakage is given as follows:

$$LE_y = LE_{d,y} + LE_{o,y} \quad (3)$$

Where:

LE_y = Leakage emissions in year y (t_{CO_2e})

$LE_{d,y}$ = Leakage emissions due to displacement of other baseline thermal energy uses of methane in year y (t_{CO_2e})

$LE_{o,y}$ = Leakage emissions due to other uncertainties in year y (t_{CO_2e})

Displacement of baseline thermal energy uses

Leakage may occur if the project activity prevents CMM/CBM from being used to meet baseline thermal energy demand, whether as a result of physical constraints on delivery, or price changes. Where regulations require that local thermal demand is met before all other uses, which is common in many jurisdictions, then this leakage could be ignored.

The boilers two of them co-fired with CMM and a gas fuelled one are the main heat supply for the regarding mine. The project operator is the only heat supplier. The heat demand has to be met before



other uses, as it is essential for the mine operation. The heat demand is changing and depends on the mine operation. Even in cases, as the CMM amount sent to the heat production decreased, there were still big amounts of CMM exhausted.

Furthermore, the price of heat produced in boilers depends on the kind of fuel and is lower if the boilers use more gas. The situation where CMM would be sent to the project activity instead to the boilers is very unlikely because of increasing heat prices.

The heat produced by the CHP units is used for the operation of the underground conditioning of the mine. It is not possible to meet this demand from other source as from the project activity.

The project activity produces power, which is one of several power sources for the mine. The production is parallel to the grid. The power demand is ensured by the local power supplier. The heat produced by the engines is used in the absorption mine air conditioning.

The leakage could be ignored as:

- as the heat demand of the mine is met before the external uses, as it is essential for the mine processes
- the other technological and economical circumstances at the project location makes leakage emissions due to displacement of other baseline thermal energy uses of methane very unlikely

Furthermore according to “Provisions for Joint Implementation small-scale project”, Version 03, leakage only has to be considered within the boundaries of non-Annex I Parties.

Emission Reduction

$$ER_y = BE_y - PE_y - LE_y \quad (4)$$

where

ER_y	=	Emission reductions of the project activity during the year y (t CO ₂)
BE_y	=	Baseline emissions during the year y (t CO ₂)
PE_y	=	Project emissions during the year y (t CO ₂)
LE_y	=	leakage emissions in year y (t CO ₂) = 0



Data / Parameter:	BE _y
Data unit:	t CO _{2Eq}
Description:	baseline emissions in year y (t _{CO_{2e}})
Time of determination/ monitoring	During the project implementation
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	Monthly recorded
Any comment:	Calculated using formulae in section B3

Data / Parameter:	BE _{MRY}
Data unit:	t CO _{2Eq}
Description:	Baseline emissions from release of methane into atmosphere in year y (t _{CO_{2e}}) that is avoided by the project activity
Time of determination/ monitoring	Ex ante
Source of data:	Monitored data
Value of data applied	0
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The emissions from release of methane into atmosphere in year y (t _{CO_{2e}}) that is avoided by the project activity are excluded for the project activity. Only CO ₂ emissions associated to the same quantity of electricity than electricity generated, as a result of the use of methane are included. In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.
QA/QC procedures:	
Any comment:	

Data / Parameter:	BE _{MDy}
Data unit:	t CO _{2Eq}
Description:	Baseline emissions from destruction of methane in the baseline in year y (t _{CO_{2e}})
Time of determination/ monitoring	Ex ante
Source of data:	
Value of data applied	0
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The emissions from destruction of methane are excluded for the project activity.
QA/QC procedures:	
Any comment:	



Data / Parameter:	$EF_{elec-gen}$
Data unit:	$t\ CO_2 / MWh$
Description:	CO_2 emission factor of the grid
Time of determination/ monitoring	
Source of data:	KOBiZE/Poland
Value of data applied	0.812 t_{CO_2}/MWh
Justification of the choice of data or description of measurement methods and procedures (to be) applied	A standardised carbon emission factor for the Polish Grid as determined by KOBiZE: http://www.kobize.pl/materialy/jicdm/JI-wskaznik_referencyjny_26sie2011_publik.pdf
QA/QC procedures:	
Any comment:	

Data / Parameter:	$EF_{Heat-gen}$
Data unit:	t_{CO_2} / GJ_{Heat}
Description:	CO_2 emission factor of coal fired heating
Time of determination/ monitoring	Ex ante
Source of data:	IPCC 2006 / Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	0.118 t_{CO_2} / GJ_{Heat}
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The standard carbon emission factor from the IPCC guidelines together with a combustion efficiency of 80% has been taken as a conservative approach. The value for "Coking Coal" / "Other Bituminous Coal" of 94.5 t_{CO_2} / TJ has been chosen. This is the value with the lowest carbon emissions, thus this is conservative for coal displacement.
QA/QC procedures:	
Any comment:	$EF_{Heat-gen} = 0.0945 / 0.8 = 0.118\ t_{CO_2} / GJ_{Heat}$

Data / Parameter:	$BE_{Use,y}$
Data unit:	$t\ CO_2Eq$
Description:	Baseline emissions from the production of power, heat or gas supply to grid replaced by the project activity in year y (tCO_2e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan. Calculated using formulae in section B3



Data / Parameter:	BE _{power,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power replaced by the project activity in year y (tCO ₂ e)
Time of determination/monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of power generation are CO ₂ emissions associated to the same quantity of electricity as electricity generated, that otherwise would be produced by combustion of fossil fuels.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	BE _{heat,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of heat replaced by the project activity in year y (tCO ₂ e)
Time of determination/monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

B.4. Further baseline information, including the date of baseline setting and the name(s) of the person(s)/entity(ies) setting the baseline:

Date of completion of the baseline study: 18 October 2012

Name of person / entity setting the baseline: Alina Mroz, / Carbon-TF B.V.

See Annex 1 for detailed contact information.

**SECTION C. Duration of the project / crediting period****C.1. Starting date of the project:**

The first operation of the project was June 2000.

C.2. Expected operational lifetime of the project:

At least 17 years, equal to 204 months. A longer operation is possible.

C.3. Length of the crediting period:

5 years (2008 – 2012), equal 60 months. First emission reduction was generated by the project January, the 1st 2008.

The crediting period can extend beyond 2012 subject to the approval by the host party.

SECTION D. Monitoring plan**D.1. Description of monitoring plan chosen:**

The JI specific approach for baseline setting and monitoring has been used for the monitoring of the proposed JI project. According to the most recent guidelines for baseline setting and monitoring (JISC18) elements of approved CDM baseline and monitoring methodologies or approved CDM methodological tools can be used, as appropriate.

Applicability requirements for the monitoring plan of the ACM0008 methodology are identical to respective requirements of the baseline setting. For a detailed overview of the ACM0008 applicability please refer to section B.I of this PDD.

General remarks to the Monitoring Plan:

- IPCC default factors have been taken from the 2006 IPCC Guidelines for National Greenhouse Gas Inventories. [IPCC-2]
- In accordance with ACM0008 only emissions reductions caused by methane that is being destroyed by the project should be measured.

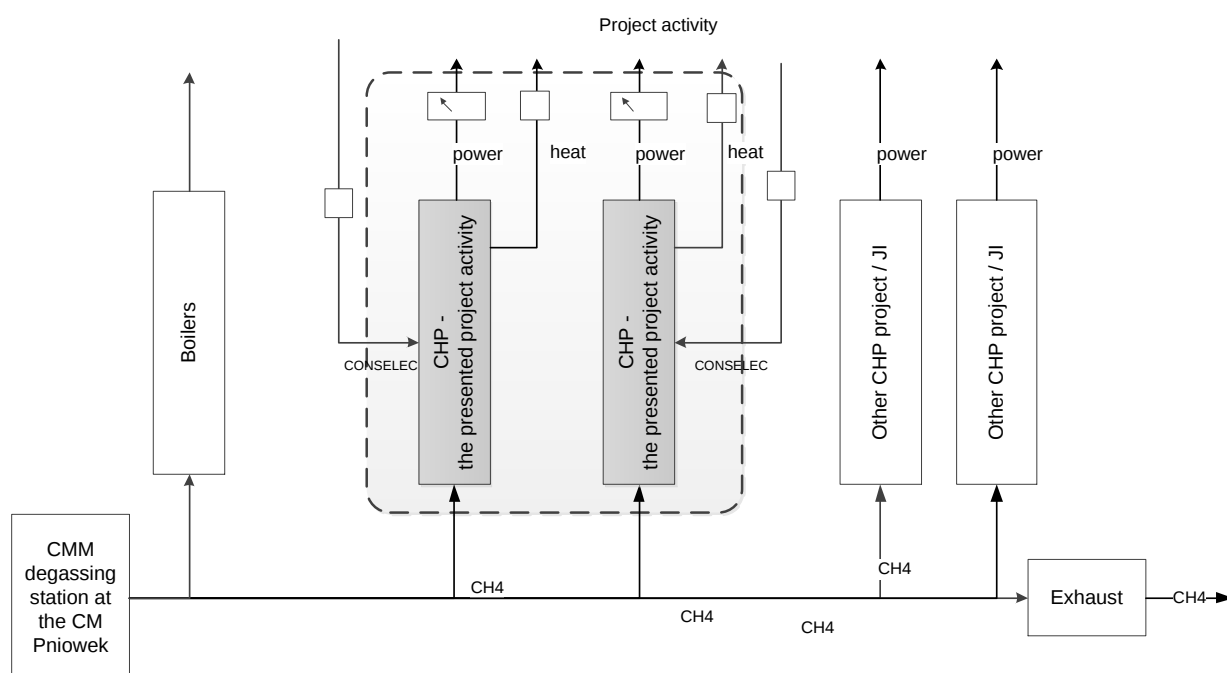


Figure D-1: Data collected for the monitoring

D.1.1. Option 1 – Monitoring of the emissions in the project scenario and the baseline scenario:

Data / Parameter:	BE _y
Data unit:	t CO _{2Eq}
Description:	baseline emissions in year y (t _{CO2e})
Time of determination/ monitoring	During the project implementation,
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	Monthly recorded
Any comment:	Calculated using formulae in section B3



Data / Parameter:	$BE_{Use,y}$
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power, heat or gas supply to grid replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan. Calculated using formulae in section B3

Data / Parameter:	$BE_{power,y}$
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of power generation are CO ₂ emissions associated to the same quantity of electricity as electricity generated, that otherwise would be produced by combustion of fossil fuels and to the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	$BE_{heat,y}$
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of heat by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or	The total emissions reductions from displacement of the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.



description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	CON _{ELEC,PJ}
Data unit:	MWh
Time of determination/monitoring	Ex post
Description:	Additional electricity consumption for use or destruction of methane, if any
Source of data:	Research, measurements
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The additional electricity consumption will be determined in dependence from the produced power
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They allow an automatic reading from the Vattenfall's control room. The operator receives additional receipts about the meter reading.
Any comment:	The power own consumption of the power generation units was estimated ex ante as of 3.5% of the generated power in other projects. This assumption made to the a JI activity was already finally determined in the Project 0078

Data / Parameter:	MM _{ELEC Engi}
Data unit:	tCH ₄
Time of determination/monitoring	monthly
Description:	Methane destroyed in the power plant
Source of data:	calculated
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The amount of methane will be estimated in dependence from the energy generation of the CHP installed in the project activity and the efficiency of the power production.
QA/QC procedures:	
Any comment:	$MM_{ELEC Engi} = EG_{Engi} / \eta_{power} / NCV_M \times \rho_{CH_4}$

Data / Parameter:	η_{power}
Data unit:	%
Time of determination/monitoring	Ex ante



Description:	Energy efficiency of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The efficiency of the plant is provided by the manufacturer
QA/QC procedures:	
Any comment:	

Data / Parameter:	NCV _M
Data unit:	TJ/Gg
Time of determination/monitoring	Ex ante
Description:	Net calorific value of methane
Source of data:	Polish legal source: Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	50
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	With 1MJ=0.2778 kWh and $\rho_{CH_4}=0.717 \text{ kg/m}^3$ NCV _M =9.96 kWh/m ³

Data / Parameter:	P _i
Data unit:	kWel
Time of determination/monitoring	Ex ante/ex post
Description:	Theoretical electrical capacity of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	The theoretical capacity is individual for the engine installed within the project activity.

Data / Parameter:	CEF _{CH₄}
Data unit:	t CO _{2eq} / t CH ₄



Time of determination/ monitoring	Carbon emission factor for combusted methane
Description:	Ex ante
Source of data:	IPCC
Value of data applied	2.75
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	

Data / Parameter:	EG _{Engi}
Data unit:	MWh
Time of determination/ monitoring	continuous
Description:	Electricity generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement with summation, recorded in the plant dairies.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They allow an automatic reading from the Vattenfall's control room. The operator receives additional receipts about the meter reading.
Any comment:	

Data / Parameter:	HG _{Engi}
Data unit:	MWh
Time of determination/ monitoring	Continuous monitored and monthly recorded
Description:	Heat generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement, monthly recorded in the plant protocols. The protocols are parts of yearly SEJ's cogeneration reports summarised for all engines installed within the project location. The quality of the monitored data for engine installed in the presented project is thus verified in advance by another accredited entity.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The heat meters fulfil the requirements for billing
Any comment:	



Data / Parameter:	EF _{elec-gen}
Data unit:	t CO ₂ / MWh
Description:	CO ₂ emission factor of the grid
Time of determination/ monitoring	Ex ante
Source of data:	KOBiZE/Poland
Value of data applied	0.812 t _{CO2} /MWh
Justification of the choice of data or description of measurement methods and procedures (to be) applied	A standardised carbon emission factor for the Polish Grid as determined by KOBiZE: http://www.kobize.pl/materialy/jicdm/JI-wskaznik_referencyjny_26sie2011_publik.pdf
QA/QC procedures:	
Any comment:	

Data / Parameter:	EF _{Heat-gen}
Data unit:	t _{CO2} /GJ _{Heat}
Description:	CO ₂ emission factor of coal fired heating
Time of determination/ monitoring	Ex ante
Source of data:	IPCC 2006 / Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	0.118t _{CO2} /GJ _{Heat}
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The standard carbon emission factor from the IPCC guidelines together with a combustion efficiency of 80% has been taken as a conservative approach. The value for “Coking Coal” / “Other Bituminous Coal” of 94.5 t _{CO2} /TJ has been chosen. This is the value with the lowest carbon emissions, thus this is conservative for coal displacement.
QA/QC procedures:	
Any comment:	EF _{Heat-gen} = 0.0945 / 0.8 = 0.118 t _{CO2} /GJ _{Heat}

**D.1.1.2. Description of formulae used to estimate project emissions
(for each gas, source etc.; emissions in units of CO₂ equivalent):**

Project emissions are defined by the following equation

$$PE_y = PE_{ME} + PE_{MD} + PE_{UM} \quad (5)$$

Where

- PE_y = Project emissions in year y (tCO₂e)
 PE_{ME} = Project emissions from energy use to capture and use methane (tCO₂e)
 PE_{MD} = Project emissions from methane destroyed (tCO₂e)
 PE_{UM} = Project emissions from un-combusted methane (tCO₂e)

Project emissions from energy use to capture and use methane (PE_{ME}), is obtained by the equation:

$$PE_{ME} = CONS_{ELEC,PJ} \times EG_{Engi} \quad (6)$$



Project emissions from methane destroyed (PE_{MD}) can be obtained by the equation

$$PE_{MD} = MM_{ELEC} \times CEF_{CH_4} \quad (7)$$

$$PE_{UM} = 0 \quad (8)$$

as only the energy displacement is taken into account within the presented project approach and the emissions associated with methane are not considered in the project.

All utilisation units are supplied with CMM from the CMM suction system of the coal mine. The CMM pressure provided by the suction system is sufficient for the operation of all utilisation units and no further compression is needed. The CMM suction system is always in operation for safety reasons in the underground of the coal mine. The CMM suction system would be also in operation in the absence of the project; in this case the part of methane would be simply blown into the atmosphere. Thus the energy use for capture of the methane is outside the project boundaries and only the part for use methane is regarded.

The power generator and the cogeneration unit need additional power especially for the cooling fans. The power amount consumed by the power generation units is taken into account as $CONS_{ELEC,PJ}$.



D.1.1.3. Relevant data necessary for determining the baseline of anthropogenic emissions of greenhouse gases by sources within the project boundary, and how such data will be collected and archived:

Data / Parameter:	BE _y
Data unit:	t CO ₂ Eq
Description:	baseline emissions in year y (tCO ₂ e)
Time of determination/ monitoring	During the project implementation,
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	Monthly recorded
Any comment:	Calculated using formulae in section B3

Data / Parameter:	BE _{Use,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power, heat or gas supply to grid replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan. Calculated using formulae in section B3



Data / Parameter:	BE _{power,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of power generation are CO ₂ emissions associated to the same quantity of electricity as electricity generated, that otherwise would be produced by combustion of fossil fuels and to the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	BE _{heat,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of heat by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	CON _{ELEC,PJ}
Data unit:	MWh
Time of determination/ monitoring	Ex post
Description:	Additional electricity consumption for use or destruction of methane, if any
Source of data:	Research, measurements
Value of data applied	
Justification of the	The additional electricity consumption will be determined in dependence



choice of data or description of measurement methods and procedures (to be) applied	from the produced power
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They allow an automatic reading from the Vattenfall's control room. The operator receives additional receipts about the meter reading.
Any comment:	The power own consumption of the power generation units was estimated ex ante as of 3.5% of the generated power in other projects. This assumption made to the a JI activity was already finally determined in the Project 0078

Data / Parameter:	MM _{ELEC Eng1}
Data unit:	tCH ₄
Time of determination/monitoring	monthly
Description:	Methane destroyed in the power plant
Source of data:	calculated
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The amount of methane will be estimated in dependence from the energy generation of the CHP installed in the project activity and the efficiency of the power production.
QA/QC procedures:	
Any comment:	$MM_{ELEC Eng1} = EG_{Eng1} / \eta_{power} / NCV_M \times \rho_{CH4}$

Data / Parameter:	η_{power}
Data unit:	%
Time of determination/monitoring	Ex ante
Description:	Energy efficiency of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The efficiency of the plant is provided by the manufacturer
QA/QC procedures:	
Any comment:	

Data / Parameter:	NCV _M
Data unit:	TJ/Gg
Time of determination/monitoring	Ex ante



Description:	Net calorific value of methane
Source of data:	Polish legal source: Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	50
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	With $1\text{MJ}=0.2778\text{ kWh}$ and $\rho_{\text{CH}_4}=0.717\text{ kg/m}^3$ $\text{NCV}_M=9.96\text{ kWh/m}^3$

Data / Parameter:	P_i
Data unit:	kWel
Time of determination/monitoring	Ex ante/ex post
Description:	Theoretical electrical capacity of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	The theoretical capacity is individual for the engine installed within the project activity.

Data / Parameter:	CEF_{CH_4}
Data unit:	$\text{t CO}_{2\text{eq}} / \text{t CH}_4$
Time of determination/monitoring	Carbon emission factor for combusted methane
Description:	Ex ante
Source of data:	IPCC
Value of data applied	2.75
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	

Data / Parameter:	EG_{Engi}
Data unit:	MWh



Time of determination/ monitoring	continuous
Description:	Electricity generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement with summation, recorded in the plant dairies.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They allow an automatic reading from the Vattenfall's control room. The operator receives additional receipts about the meter reading.
Any comment:	

Data / Parameter:	HG _{Engi}
Data unit:	MWh
Time of determination/ monitoring	Continuous monitored and monthly recorded
Description:	Heat generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement, monthly recorded in the plant protocols. The protocols are parts of yearly SEJ's cogeneration reports summarised for all engines installed within the project location. The quality of the monitored data for engine installed in the presented project is thus verified in advance by another accredited entity.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The heat meters fulfil the requirements for billing
Any comment:	

Data / Parameter:	EF _{elec-gen}
Data unit:	t CO ₂ / MWh
Description:	CO ₂ emission factor of the grid
Time of determination/ monitoring	Ex ante
Source of data:	KOBiZE/Poland
Value of data applied	0.812 t _{CO2} /MWh
Justification of the choice of data or description of measurement methods and procedures (to be) applied	A standardised carbon emission factor for the Polish Grid as determined by KOBiZE: http://www.kobize.pl/materialy/jicdm/JI-wskaznik_referencyjny_26sie2011_publik.pdf
QA/QC procedures:	



Any comment:	
--------------	--

Data / Parameter:	$EF_{Heat-gen}$
Data unit:	t_{CO_2} / GJ_{Heat}
Description:	CO ₂ emission factor of coal fired heating
Time of determination/monitoring	Ex ante
Source of data:	IPCC 2006 / Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	$0.118 t_{CO_2} / GJ_{Heat}$
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The standard carbon emission factor from the IPCC guidelines together with a combustion efficiency of 80% has been taken as a conservative approach. The value for “Coking Coal” / “Other Bituminous Coal” of $94.5 t_{CO_2} / TJ$ has been chosen. This is the value with the lowest carbon emissions, thus this is conservative for coal displacement.
QA/QC procedures:	
Any comment:	$EF_{Heat-gen} = 0.0945 / 0.8 = 0.118 t_{CO_2} / GJ_{Heat}$

D.1.1.4. Description of formulae used to estimate baseline emissions (for each gas, source etc.; emissions in units of CO₂ equivalent):

$$BE_y = BE_{MR,y} + BE_{Use,y} \quad (9)$$

The baseline emissions from release of methane into the atmosphere in the year y ($BE_{MR,y}$) are not taken into account for the purposes of the project

$$BE_{MR,y} = 0$$

The emissions reductions from displacement of power/heat generation are described as follows:

$$BE_{Use,y} = EG_{Engi} \times EF_{elec} + HG_{Engi} \times EF_{Heat-gen} \quad (10)$$

D. 1.2.Option 2 – Direct monitoring of emission reductions from the project (values should be consistent with those in section E.):

Data / Parameter:	
Data unit:	
Description:	
Time of determination/monitoring	
Source of data:	
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	



Any comment:

not applicable

D.1.2.2. Description of formulae used to calculate emission reductions from the project (for each gas, source etc.; emissions/emission reductions in units of CO₂ equivalent):

not applicable

D.1.3. Treatment of leakage in the monitoring plan:

In accordance with ACM0008 the following leakages should be considered:

1. Displacement of baseline thermal energy uses
2. CBM drainage from outside the de-stressed zone
3. Impact of the emission reducing project on coal production
4. Impact of the emission reducing project on coal prices

Leakage in the project is very unlikely as:

1. the heat demand of the mine is met before the external uses, because it is essential for the mine processes. The amount of captured methane was furthermore every month bigger as the summarised project and baseline demand till now
2. The heat generated by the project is used for a device which is an integrated part of the project and which heat demand cannot be met by using other sources
3. There is no CBM involved hence no leakage occurs from CBM drainage from outside the de-stressed zone
4. There is no impact of the emission reducing project on coal production as degasification activities are independent from the emission reducing project
5. The impact of the emission reducing project on coal prices is difficult to assess. The revenues from carbon trading are for the project operator, not for the mine, and necessary for an economic viability of the presented project. The emission reducing project as such does not influence coal production so it is unlikely that the emission reducing project will impact coal prices

D.1.3.1. If applicable, please describe the data and information that will be collected in order to monitor leakage effects of the project:

not applicable

D.1.3.2. Description of formulae used to estimate leakage (for each gas, source etc.; emissions in units of CO₂ equivalent):

not applicable

**D.1.4. Description of formulae used to estimate emission reductions for the project (for each gas, source etc.; emissions/emission reductions in units of CO₂ equivalent):**

The greenhouse gas emission reduction gained by the project over a period is the difference between the total baseline emissions over the period and the total project emissions over the period. This is given by the equation:

$$ER_y = BE_y - PE_y \quad (11)$$

where:

- ER_y Emissions reductions of the project activity during the year y (t CO_{2eq})
BE_y Baseline emissions during the year y (t CO_{2eq})
PE_y Project emissions during the year y (t CO_{2eq})

D.1.5. Where applicable, in accordance with procedures as required by the host Party, information on the collection and archiving of information on the environmental impacts of the project:

To maintain a consistent and reliable performance of the automatic controlling and monitoring system an adequate quality control and assurance procedures will be implemented that is regulated by the calibration standards and quality norms of the national legislation. Under these requirements of quality control system, regular maintenance and testing regime to ensure accuracy of flow meters, gas-analysers, electricity and heat measuring instruments will be provided. All measuring instruments will be calibrated periodically. The calibration protocols will be archived and proved by an independent entity on an annual basis. A consistency check for all measurement data and the calculation of the emission reductions will be carried out and reported monthly.



D.2. Quality control (QC) and quality assurance (QA) procedures undertaken for data monitored:		
Data	Uncertainty level of data (high/medium/low)	Explain QA/QC procedures planned for these data, or why such procedures are not necessary.
<i>Power production</i>	low	The indication of the measurement instrument should be controlled one-time during the final inspection by the manufacturer. The gauge has usually hardly any fluctuations and no recalibration is needed. The indication of the measurement instrument should be controlled during the regular inspections while the operation time and a gauge which is obviously out of order should be substituted.
<i>Heat production</i>	low	The indication of the measurement instrument should be controlled one-time during the final inspection by the manufacturer. The heat measuring device has usually hardly any fluctuations and no recalibration is needed. The indication of the measurement instrument should be controlled during the regular inspections while the operation time and a gauge which is obviously out of order should be substituted.

Irrespective the monitoring plan all installed aggregates and gauges should be controlled during the regular inspections, at least weakly, to assure a proper operation of the facility. Beside the monitored values any other values which are needed for the supervision of the plant should be logged.

Any gauge or apparatus which is detected as obviously out of order should be substituted.

Furthermore emissions measurement for dust, CO, NO_x etc. for all combustion units will be carried out and archived as required by the legal requirements of the Polish Authorities.

D.3. Please describe the operational and management structure that the project operator will apply in implementing the monitoring plan:

The plants installed in the project are designed to run fully automatic, so that the operating personnel have only to supervise the correct operation of the plant and the plausibility of the collected and monitored data. In case of disturbances the plant will be shut down automatically and no unintended emissions are caused.

The operator of the degassing station is responsible for the measurement of the whole amount of captured methane, the amount of methane sent to the operator of proposed project and the amount of captured methane vented. The amounts are documented monthly and given to the mine's and project operator's representatives. The measured amounts are relevant for mine's invoices for the CMM used by the project operator.

The protocols should be stored as a part of balance of the operating company.

All stored data will be kept during the whole operation period of the plant and furthermore for at least 5 years.

This template shall not be altered. It shall be completed without modifying/adding headings or logo, format or font.



The project operator measures the methane amounts sent to his plants: the proposed project activity and the boilers. The last devices destruct methane in the baseline and the emission reduction achieved by them will not be taken under account.

The relevant process data collected by the project operator are: CHP-worked hours, heat and power production. The power plant and all relevant process data are to be observed daily by the staff. The process data are to be collected and archived monthly. The monthly report has to be printed for archiving and the plant manager's validation.

The power production is measured by measuring devices maintained by the grid operator, as they are relevant for invoicing. In addition they are necessary for requesting of cogeneration certificates. The readout of the measurement is made automatically by the grid operator. The quality of the measurement is thereafter high.

The heat production is measured by measuring devices maintained by the project operator, as they are relevant for invoicing. In addition they are necessary for requesting of cogeneration certificates. The readout of the measurement is made by the project operator and thereafter verified by an accredited entity in accordance with the requirements of Polish Energy Law. The quality of the measurement is thereafter high.

The power and heat monthly reports are parts of yearly SEJ's cogeneration reports summarised for all engines installed within the project location. The quality of the monitored data for engine installed in the presented project is thus verified in advance by another accredited entity.

All printed and validated reports and invoices are to be stored for at least 5 years. A storage of scanned reports is allowed, due to the internal quality guidelines of the project operator. The quality of management systems of the project operator is certified by ISO procedure.

All measuring equipment is to calibrate according to the legal requirements and manufacturers guidelines.

The plant manager is responsible for the preparation of the standardised monthly report. He is also in charge for the preparation of the summarised monthly and yearly reports, which should be revised by the project manager.

The plant manager is keeping an operational journal which includes the following information:

- compilation and description of all data recorded, required for the calculation of the emission reductions
- description of all records to be kept during the regular inspections, including all corrective action undertaken
- manually logged data collected during the regular inspections
- particular events
- all calibrations carried out, incl. all calibration protocols

All data should be continuously checked for consistency, completeness and integrity by project developer (SEJ). A detailed plausibility check should be carried out at least monthly.

Based on the procedure described above a detailed annual report should be prepared by SEJ and confirmed by the verifier.



The responsible staff members of the project operator SEJ have been trained on the handling with CMM-utilisation units and the applied monitoring systems by the plant producer. Those trained personnel of the operator is the basis and responsible for operating and monitoring of this project.

D.4. Name of person(s)/entity(ies) establishing the <u>monitoring plan</u>:
--

Date of completion of the monitoring plan: 18 October 2012

Name of person / entity setting the monitoring plan: Alina Mroz/ Carbon-TF B.V.

See Annex 1 for detailed contact information.

**SECTION E. Estimation of greenhouse gas emission reductions****E.1. Estimated project emissions:**

The following calculations are based on the baseline determined in section B

Table E-1 – Estimated project emissions

Estimated project emissions [t CO₂Eq]					
Year	2008	2009	2010	2011	2012
CO ₂ emission from					
Fuel combustion	29,807	29,807	29,807	29,807	29,807
additional power consumption	1,626	1,626	1,626	1,626	1,626
sum	31,433	31,433	31,433	31,433	31,433

E.2. Estimated leakage:

There is no leakage estimated in this project.

E.3. The sum of E.1. and E.2.:*Table E-3 – Estimated project emissions and leakage*

Estimated project emissions and leakage [t CO₂Eq]					
Year	2008	2009	2010	2011	2012
CO ₂ emission from					
Fuel combustion	29,807	29,807	29,807	29,807	29,807
additional power consumption	1,626	1,626	1,626	1,626	1,626
sum	31,433	31,433	31,433	31,433	31,433

E.4. Estimated baseline emissions:*Table E-4 – Estimated baseline emissions*

Estimated baseline emissions [t CO₂Eq]					
Year	2008	2009	2010	2011	2012
release of methane that is avoided by the project					
flaring	0	0	0	0	0
heat generation	0	0	0	0	0
power generation	0	0	0	0	0
production of heat that is displaced by the project	28,974	28,974	28,974	28,974	28,974
production of power that is displaced by the project	46,455	46,455	46,455	46,455	46,455
sum	75,429	75,429	75,429	75,429	75,429

**E.5. Difference between E.4. and E.3. representing the emission reductions of the project:**

See table E-6 in section E.6.

E.6. Table providing values obtained when applying formulae above:*Table E-6 – Project emissions and emission reductions during the lifetime of the project (2008-2012)*

Year	Estimated project emissions (tonnes of CO2 equivalent)	Estimated leakage (tonnes of CO2 equivalent)	Estimated baseline emissions (tonnes of CO2 equivalent)	Estimated emissions reductions (tonnes of CO2 equivalent)
2008	31,433	-	75,429	43,996
2009	31,433	-	75,429	43,996
2010	31,433	-	75,429	43,996
2011	31,433	-	75,429	43,996
2012	31,433	-	75,429	43,996
Total (tonnes of CO2 equivalent)	157,166	-	377,146	219,979

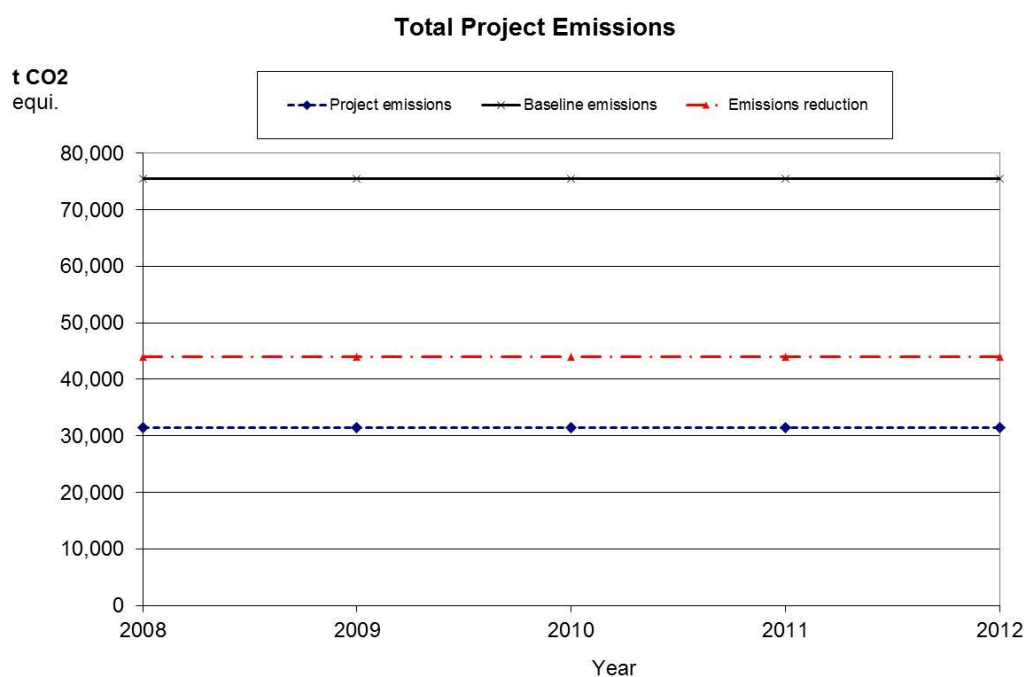


Figure E-1 - Baseline emissions, project emissions and emissions reduction; total project

**SECTION F. Environmental impacts****F.1. Documentation on the analysis of the environmental impacts of the project, including transboundary impacts, in accordance with procedures as determined by the host Party:**

The CHP-unit does not use the natural resources: water, ground and landscape, so that no impairment on nature or landscape is given. The facility does not produce any waste, sewage or condensate. Due to the very high operational safety standards supplied a very low accident hazard is given.

The plant requires an approval by the Polish Environmental Authorities. The combustion processes are designed to comply for the Polish emissions limits.

The facility causes no harmful environmental impacts. In fact the energy produced by the plant displaces the amount of energy from fossil fuels and reduces so the CO₂ emissions associated with them.

Furthermore the utilisation of otherwise unused CMM reduces in an active manner the amount of CMM which is released to the atmosphere and provides significant benefits for the global climate production by converting the harmful methane into the less harmful carbon dioxide.

Furthermore the operation of the plant creates additional jobs.

Beside the positive effect on the global climate protection, no transboundary impacts occur.

F.2. If environmental impacts are considered significant by the project participants or the host Party, please provide conclusions and all references to support documentation of an environmental impact assessment undertaken in accordance with the procedures as required by the host Party:

There are no significant environmental impacts expected (see Section F.1). The plant fulfils Polish administrative and legal requirements, which was proven within the regulatory procedures of the host country prior to the plant start-up and if necessary during the operation. All relevant environmental permissions for the construction and operation of the plant were obtained.

**SECTION G. Stakeholders' comments****G.1. Information on stakeholders' comments on the project, as appropriate:**

A local stakeholder consultation is required during the authorization procedure, by the building law, the law of city and regional planning, environmental law. The stakeholder rights are described in the administrative law. The stakeholders were consulted according to the regulations.

The project operator SEJ has applied for the building permit in accordance with the current legislation.

Parties involved in the procedure were: Municipality Pawlowice, District Building Supervision in Pszczyna, District Mining Authority

As the necessary preliminary administrative step was the achieving of a decision about the conditions for the building development plan. This decision was given by the Municipality Pawlowice after examination of the ownership right and other stakeholder's rights and interests.

According to the Polish legislation every stakeholder can raise objection, if his rights and interests are put at risk.

During the plant building the stakeholders had to be informed about the character of the plant and all risks that could occur.

No objections were raised; neither during the administrative procedure nor during the construction and operational time of the plant.

The strategy of the project developer (SEJ) and its parent company for avoidance of methane emission were made public. The plans for the presented project were published both in local and scientific journals. The intention of project implementation as emission reduction generating project was published.

Annex 1**CONTACT INFORMATION ON PROJECT PARTICIPANTS****Project operator**

Organization:	Spolka Energetyczna Jastrzebie
Street/P.O.Box:	ul. Rybnicka
Building:	6c
City:	Jastrzębie Zdrój
State/Region:	
Postal code:	44-335
Country:	Poland
Phone:	+ 48 32 471 69 79
Fax:	+ 48 32 471 85 59
E-mail:	
URL:	
Represented by:	Jaroslav Parma
Title:	CEO
Salutation:	Mr.
Last Name:	Parma
Middle Name:	
First Name:	Jaroslav
Department:	
Phone(direct):	+ 48 32 471 69 79
Fax (direct):	
Mobile:	
Personal e-mail:	jparma@sejsa.com.pl

**Consultant and investor, buyer of the emission reduction certificates**

Organization:	Carbon-TF B.V.
Street/P.O.Box:	Kaldenkerkerweg 158
Building:	
City:	Tegelen (Venlo)
State/Region:	
Postal code:	5932 CZ
Country:	Netherlands
Phone:	+31 (0) 77 351 7985
Fax:	+31 (0) 77 354 8687
E-mail:	info@carbon-tf.com
URL:	www.carbon-tf.com
Represented by:	Clemens Backhaus
Title:	Managing Director
Salutation:	
Last Name:	Backhaus
First Name:	Clemens
Department:	
Phone(direct):	
Fax (direct):	
Mobile:	
Personal e-mail:	ba@carbon-tf.com

Contact person for the purpose of the project:

Organization:	Carbon-TF B.V.
Street/P.O.Box:	Kaldenkerkerweg 158
Building:	
City:	Tegelen (Venlo)
State/Region:	
Postal code:	5932 CZ
Country:	Netherlands
Phone:	
Fax:	+31 (0) 77 354 8687
E-mail:	info@carbon-tf.com
URL:	www.carbon-tf.com
Contact person:	Alina Mroz
Title:	Director Business Development
Salutation:	
Last Name:	Mroz
First Name:	Alina
Mobile:	+49 (0) 173 98 00 663
Personal e-mail:	mr@carbon-tf.com



Annex 2

BASELINE INFORMATION

Justification of the amounts taken for the baseline estimation

Evaluation of the energy amount, which is to produce within the project, was based on the size of the utilisation units appropriate for the utilisation of the forecasted CMM amounts. The first operational results of the installed equipment proved the correctness of the assumptions. The supporting documents regarding the assumption were provided to the AIE.

Power own consumption of the cogeneration units

The power own consumption of the power generation units is estimated ex ante as of 3.5% of the generated power. This ratio is based on the experience made with over 100 CMM CHP modules in Europe.

Project emission

The project emissions during the down times of the plant are not considered in the calculation. As they are very small and not significant, they are not necessary to be encompassed by the project boundaries. This is in accordance with the JISC's Guidance on criteria for baseline setting and monitoring.

Baseline Carbon Emission Factor for Coal

The standard carbon emission factor from the IPCC 2006 guidelines and Polish legal source: 2008/Dz.Ust 183/1142 together with a combustion efficiency of 80% has been taken as a conservative approach, corresponding to the reference efficiency for the Polish cogeneration reporting according to the Energy Law.

The value for "Coking Coal" / "Other Bituminous Coal" of 94.5 tCO₂ /TJ has been chosen. This is the value with the lowest carbon emissions, thus this is conservative for coal displacement.

Baseline Carbon Emission Factor for the Polish power grid

A standardised carbon emission factor for the Polish Grid as determined by KOBiZE
http://www.kobize.pl/materialy/jicdm/JI-wskaznik_referencyjny_26sie2011_publik.pdf

**Key elements of the baseline:**

Data / Parameter:	BE _y
Data unit:	t CO ₂ Eq
Description:	baseline emissions in year y (tCO ₂ e)
Time of determination/ monitoring	During the project implementation,
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	Monthly recorded
Any comment:	Calculated using formulae in section B3

Data / Parameter:	BE _{Use,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power, heat or gas supply to grid replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan. Calculated using formulae in section B3

Data / Parameter:	BE _{power,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of power replaced by the project activity in year y (tCO ₂ e)
Time of determination/ monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of	The total emissions reductions from displacement of power generation are CO ₂ emissions associated to the same quantity of electricity as electricity generated, that otherwise would be produced by combustion of fossil fuels and to the



measurement methods and procedures (to be) applied	same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	BE _{heat,y}
Data unit:	t CO ₂ Eq
Description:	Baseline emissions from the production of heat by the project activity in year y (tCO ₂ e)
Time of determination/monitoring	During the project duration
Source of data:	Monitored data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The total emissions reductions from displacement of the same quantity of heat as heat generated, that otherwise would be produced in coal boilers.
QA/QC procedures:	
Any comment:	In order to avoid of double counting of emissions the emission reduction caused by the project activity is to proceed from the appropriate set-aside in the national allocation plan.

Data / Parameter:	CON _{ELEC,PJ}
Data unit:	MWh
Time of determination/monitoring	Ex post
Description:	Additional electricity consumption for use or destruction of methane, if any
Source of data:	Research, measurements
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The additional electricity consumption will be determined in dependence from the produced power
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They allow an automatic reading from the 's control room. The operator receives additional receipts about the meter reading.
Any comment:	The power own consumption of the power generation units was estimated ex ante as of 3.5% of the generated power in other projects. This assumption made to the a JI activity was already finally determined in the Project 0078



Data / Parameter:	MM _{ELEC} Eng1
Data unit:	tCH ₄
Time of determination/ monitoring	monthly
Description:	Methane destroyed in the power plant
Source of data:	calculated
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The amount of methane will be estimated in dependence from the energy generation of the CHP installed in the project activity and the efficiency of the power production.
QA/QC procedures:	
Any comment:	$MM_{ELEC\ Eng1} = EG_{Eng1} / \eta_{power} / NCV_M \times \rho_{CH4}$

Data / Parameter:	η_{power}
Data unit:	%
Time of determination/ monitoring	Ex ante
Description:	Energy efficiency of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The efficiency of the plant is provided by the manufacturer
QA/QC procedures:	
Any comment:	

Data / Parameter:	NCV _M
Data unit:	TJ/Gg
Time of determination/ monitoring	Ex ante
Description:	Net calorific value of methane
Source of data:	Polish legal source: Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	50
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	With 1MJ=0.2778 kWh and $\rho_{CH4}=0.717\text{ kg/m}^3$ NCV _M =9.96 kWh/m ³



Data / Parameter:	P_i
Data unit:	kWel
Time of determination/ monitoring	Ex ante/ex post
Description:	Theoretical electrical capacity of the plant
Source of data:	Manufacturer's data
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	The theoretical capacity is individual for the engine installed within the project activity.

Data / Parameter:	CEF_{CH_4}
Data unit:	$t\ CO_{2eq} / t\ CH_4$
Time of determination/ monitoring	Carbon emission factor for combusted methane
Description:	Ex ante
Source of data:	IPCC
Value of data applied	2.75
Justification of the choice of data or description of measurement methods and procedures (to be) applied	
QA/QC procedures:	
Any comment:	

Data / Parameter:	EG_{Engi}
Data unit:	MWh
Time of determination/ monitoring	Continuous monitored and monthly recorded
Description:	Electricity generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement with summation, recorded in the plant dairies.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The power meters fulfill the requirements for billing. They



	allow an automatic reading from the Vattenfall's control room. The operator receives additional receipts about the meter reading.
Any comment:	

Data / Parameter:	HG Engi
Data unit:	MWh
Time of determination/ monitoring	Continuous monitored and monthly recorded
Description:	Heat generation
Source of data:	measured
Value of data applied	
Justification of the choice of data or description of measurement methods and procedures (to be) applied	Continuous measurement, monthly recorded in the plant protocols. The protocols are parts of yearly SEJ's cogeneration reports summarised for all engines installed within the project location. The quality of the monitored data for engine installed in the presented project is thus determined in advance by another accredited entity.
QA/QC procedures:	Calibration according to the producer instructions, legal and operation requirements. The heat meters fulfil the requirements for billing
Any comment:	



Data / Parameter:	$EF_{elec-gen}$
Data unit:	$t\ CO_2 / MWh$
Description:	CO_2 emission factor of the grid
Time of determination/ monitoring	
Source of data:	KOBiZE/Poland
Value of data applied	0.812 t_{CO_2}/MWh
Justification of the choice of data or description of measurement methods and procedures (to be) applied	A standardised carbon emission factor for the Polish Grid as determined by KOBiZE: http://www.kobize.pl/materialy/jicdm/JI-wskaznik_referencyjny_26sie2011_publik.pdf
QA/QC procedures:	
Any comment:	

Data / Parameter:	$EF_{Heat-gen}$
Data unit:	t_{CO_2} / GJ_{Heat}
Description:	CO_2 emission factor of coal fired heating
Time of determination/ monitoring	Ex ante
Source of data:	IPCC 2006 / Polish legal source: 2008/Dz.Ust 183/1142
Value of data applied	0.118 t_{CO_2} / GJ_{Heat}
Justification of the choice of data or description of measurement methods and procedures (to be) applied	The standard carbon emission factor from the IPCC guidelines together with a combustion efficiency of 80% has been taken as a conservative approach. The value for “Coking Coal” / “Other Bituminous Coal” of 94.5 t_{CO_2} / TJ has been chosen. This is the value with the lowest carbon emissions, thus this is conservative for coal displacement.
QA/QC procedures:	
Any comment:	$EF_{Heat-gen} = 0.0945 / 0.8 = 0.118\ t_{CO_2} / GJ_{Heat}$



Annex 3

MONITORING PLAN

The monitoring plan is listed in section D.