



# VERIFICATION REPORT VEMA S.A.

VERIFICATION OF THE  
MODERNIZATION OF ELECTRIC  
POWER DISTRIBUTION SYSTEM AT  
PJSC “PC “KHERSONOBLENERGO”  
THE SECOND PERIODIC  
FOR THE PERIOD 01/01/2011 – 31/12/2011

REPORT No. UKRAINE-VER/0479/2012

REVISION No. 01

BUREAU VERITAS CERTIFICATION



## VERIFICATION REPORT

Date of first issue: 03/04/2012	Organizational unit: Bureau Veritas Certification Holding SAS
Client: VEMA S.A.	Client ref.: Fabian Knodel

## Summary:

Bureau Veritas Certification has made the second periodic verification of the “Modernization of electric power distribution system at PJSC “PC “Khersonoblenergo” project of VEMA S.A., located in Kherson region, Ukraine, and applying JI specific approach, on the basis of UNFCCC criteria for the JI, as well as criteria given to provide for consistent project operations, monitoring and reporting. UNFCCC criteria (but for the crediting period) refer to Article 6 of the Kyoto Protocol, the JI rules and modalities and the subsequent decisions by the JI Supervisory Committee, as well as the host country criteria.

The verification scope is defined as a periodic independent review and ex post determination by the Accredited Entity of the monitored reductions in GHG emissions during defined verification period, and consisted of the following three phases: i) desk review of the monitoring report against project design and the baseline and monitoring plan; ii) follow-up interviews with project stakeholders; iii) resolution of outstanding issues and the issuance of the final verification report and opinion. The overall verification, from Contract Review to Verification Report & Opinion, was conducted using Bureau Veritas Certification internal procedures.

The first output of the verification process is a list of Clarification, Corrective Actions Requests, Forward Actions Requests (CL, CAR and FAR), presented in Appendix A.

In summary, Bureau Veritas Certification confirms that the project is implemented as planned and described in approved project design documents. Installed equipment being essential for generating emission reduction runs reliably and is calibrated appropriately. The monitoring system is in place and the project is generating GHG emission reductions. The GHG emission reduction is calculated accurately and without material errors, omissions, or misstatements, and the emission reductions totalize 664 088 tonnes of CO<sub>2</sub> equivalent for the monitoring period from 01/01/2011 to 31/12/2011.

Our opinion relates to the project’s GHG emissions and resulting GHG emission reductions reported and related to the approved project baseline and monitoring, and its associated documents.

Report No.: UKRAINE-ver/0479/2012	Subject Group: JI	
Project title: Modernization of electric power distribution system at PJSC “PC “Khersonoblenergo”		
Work carried out by: Oleg Skoblyk - Team Leader, Lead Verifier Serhii Verteletskiy - Team member, Verifier Trainee Daniil Ukhanov - Technical Specialist		
Work reviewed by: Ivan Sokolov - Internal Technical Reviewer Vyacheslav Yeromin – Technical Specialist		
Work approved by: Ivan Sokolov – Operational Manager		
Date of this revision: 03/04/2012	Rev. No.: 01	Number of pages: 31

- No distribution without permission from the Client or responsible organizational unit
- Limited distribution
- Unrestricted distribution



<b>Table of Contents</b>		<b>Page</b>
1	INTRODUCTION .....	4
1.1	Objective	4
1.2	Scope	4
1.3	Verification Team	4
2	METHODOLOGY .....	5
2.1	Review of Documents	5
2.2	Follow-up Interviews	6
2.3	Resolution of Clarification, Corrective and Forward Action Requests	6
3	VERIFICATION CONCLUSIONS .....	7
3.1	Remaining issues and FARs from previous verifications	7
3.2	Project approval by Parties involved (90-91)	7
3.3	Project implementation (92-93)	8
3.4	Compliance of the monitoring plan with the monitoring methodology (94-98)	10
3.5	Revision of monitoring plan (99-100)	10
3.6	Data management (101)	10
3.7	Verification regarding programmes of activities (102-110)	12
4	VERIFICATION OPINION .....	12
5	REFERENCES .....	14
	APPENDIX A: PROJECT VERIFICATION PROTOCOL .....	19



## 1 INTRODUCTION

VEMA S.A. has commissioned Bureau Veritas Certification to verify the emissions reductions of its JI project “Modernization of electric power distribution system at PJSC “PC “Khersonoblenergo” (hereafter called “the project”) located in Kherson region, Ukraine.

This report summarizes the findings of the verification of the project, performed on the basis of UNFCCC criteria, as well as criteria given to provide for consistent project operations, monitoring and reporting, as well as the host country criteria.

The verification covers the period from January 1, 2011 to December 31, 2011.

### 1.1 Objective

Verification is the periodic independent review and ex post determination by the Accredited Independent Entity (AIE) of the monitored reductions in GHG emissions during defined verification period.

The objective of verification can be divided in Initial Verification and Periodic Verification.

UNFCCC criteria refer to Article 6 of the Kyoto Protocol, the JI rules and modalities and the subsequent decisions by the JI Supervisory Committee, as well as the host country criteria.

### 1.2 Scope

The verification scope is defined as an independent and objective review of the project design document, the project’s baseline study, monitoring plan and monitoring report, and other relevant documents. The information in these documents is reviewed against Kyoto Protocol requirements, UNFCCC rules and associated interpretations.

The verification is not meant to provide any consulting towards the Client. However, stated requests for clarifications, corrective and/or forward actions may provide input for improvement of the project monitoring towards reductions in the GHG emissions.

### 1.3 Verification Team

The verification team consists of the following personnel:

Oleg Skoblyk  
Team Leader, Bureau Veritas Certification Climate Change Lead Verifier

Serhii Verteletskiy



Team Member, Bureau Veritas Certification Climate Change Verifier  
Trainee  
Daniil Ukhanov  
Team Member, Bureau Veritas Certification Technical Specialist

This verification report was reviewed by:

Ivan Sokolov  
Bureau Veritas Certification, Internal Technical Reviewer

Vyacheslav Yeromin  
Bureau Veritas Certification, Technical Specialist

## 2 METHODOLOGY

The overall verification, from Contract Review to Verification Report & Opinion, was conducted using Bureau Veritas Certification internal procedures.

In order to ensure transparency, a verification protocol was customized for the project, according to the version 01 of the Joint Implementation Determination and Verification Manual, issued by the Joint Implementation Supervisory Committee at its 19 meeting on 04/12/2009. The protocol shows, in a transparent manner, criteria (requirements), means of verification and the results from verifying the identified criteria. The verification protocol serves the following purposes:

- It organizes, details and clarifies the requirements a JI project is expected to meet;
- It ensures a transparent verification process where the verifier will document how a particular requirement has been verified and the result of the verification.

The completed verification protocol is enclosed in Appendix A to this report.

### 2.1 Review of Documents

The Monitoring Report (MR) submitted by VEMA S.A. and additional background documents related to the project design and baseline, i.e. country Law, Project Design Document (PDD), Determination Report of this project issued by Bureau Veritas Certification Holding SAS, No. UKRAINE-det/0268/2011 dated 08/07/2011, Guidance on criteria for baseline setting and monitoring, Host party criteria, Kyoto Protocol, Clarifications on Verification Requirements to be Checked by an Accredited Independent Entity were reviewed.

The verification findings presented in this report relate to the Monitoring Report for the period from 01/01/2011 to 31/12/2011 version 01 dated



February 13, 2012 and version 02 dated April 02, 2012, and the project as described in the determined PDD.

## 2.2 Follow-up Interviews

On 29/03/2012 Bureau Veritas Certification verification team conducted a visit to the project site and performed (on-site) interviews with project stakeholders to confirm selected information and to resolve issues identified in the document review. Representatives of VEMA S.A. and PJSC “PC “Khersonoblenergo” were interviewed (see References). The main topics of the interviews are summarized in Table 1.

**Table 1 Interview topics**

Interviewed organization	Interview topics
PJSC “PC “Khersonoblenergo”	<ul style="list-style-type: none"> <li>➤ Organizational structure</li> <li>➤ Responsibilities and authorities</li> <li>➤ Personnel training</li> <li>➤ Quality control procedures and technology</li> <li>➤ Equipment use (records)</li> <li>➤ Metering equipment control</li> <li>➤ Metering record keeping system, database</li> </ul>
Consultant: VEMA S.A.	<ul style="list-style-type: none"> <li>➤ Baseline methodology</li> <li>➤ Monitoring plan</li> <li>➤ Monitoring report</li> <li>➤ Deviations from the PDD</li> </ul>

## 2.3 Resolution of Clarification, Corrective and Forward Action Requests

The objective of this phase of the verification is to raise the requests for corrective actions and clarification and any other outstanding issues that needed to be clarified for Bureau Veritas Certification positive conclusion on the GHG emission reduction calculation.

If the Verification Team, in assessing the monitoring report and supporting documents, identifies issues that need to be corrected, clarified or improved with regard to the monitoring requirements, it should raise these issues and inform the project participants of these issues in the form of:

(a) Corrective action request (CAR), requesting the project participants to correct a mistake that is not in accordance with the monitoring plan;



(b) Clarification request (CL), requesting the project participants to provide additional information for the Verification Team to assess compliance with the monitoring plan;

(c) Forward action request (FAR), informing the project participants of an issue, relating to the monitoring that needs to be reviewed during the next verification period.

The Verification Team will make an objective assessment as to whether the actions taken by the project participants, if any, satisfactorily resolve the issues raised, if any, and should conclude its findings of the verification.

To guarantee the transparency of the verification process, the concerns raised are documented in more detail in the verification protocol in Appendix A.

### **3 VERIFICATION CONCLUSIONS**

In the following sections, the conclusions of the verification are stated.

The findings from the desk review of the original monitoring documents and the findings from interviews during the follow up visit are described in the Verification Protocol in Appendix A.

The Clarification, Corrective and Forward Action Requests are stated, where applicable, in the following sections and are further documented in the Verification Protocol in Appendix A. The verification of the Project resulted in 11 Corrective Action Requests and 3 Clarification Requests.

The number between brackets at the end of each section corresponds to the DVM paragraph.

#### **3.1 Remaining issues and FARs from previous verifications**

There aren't any remaining CLs, CARs and FARs from previous verifications.

#### **3.2 Project approval by Parties involved (90-91)**

The project obtained approval from the Host party (Ukraine) - Letter of Approval No. 2485/23/7 dated 12/09/2011 issued by the State Environmental Investment Agency of Ukraine and written project approval from the party – buyer of emission reductions units (Switzerland) - Letter of Approval No. J294-0485 dated 28/06/2011 issued by the Federal Office for the Environment (FOEN) of Switzerland.

The abovementioned written approvals are unconditional.



The identified areas of concern as to the project approval by Parties involved, project participants response and BVC's conclusion are described in Appendix A to this report (refer to CAR 01).

### **3.3 Project implementation (92-93)**

The project which is implemented at the Public Joint Stock Company "Power Company "Khersonoblenergo" (hereinafter - PJSC "PC "Khersonoblenergo") provides for the implementation of the program on the technical improvement of electrical grids and equipment, advanced technologies implementation, the transition to a higher level of organization of transmission and distribution of electric energy. These activities are aimed at improvement of the reliability and efficiency of power distribution grids of PJSC "PC "Khersonoblenergo". This, in turn, will help to reduce the amount of electricity that is lost during its transportation to the consumers of all forms of ownership, so the production of electricity at power plants decreases and thus GHG emissions into the atmosphere will decrease in comparison to the situation that would exist without the project implementation.

The project scenario provides for implementation of new energy efficient equipment and a set of organizational and technical measures aimed at reduction of process losses of electricity (hereinafter – PLE) in the course of electricity transmission. The project also provides for implementation of measures on development and improvement of methodological support of reduction of PLE in the course of carrying out of licensed types of activity of electricity supply and transmission. These measures include modernization work and renewal work in the electricity grids as well as implementation of new energy efficient equipment; improvement of the reliability of electricity supply; introduction of automated system of electricity consumption commercial accounting (ASECCA) within the framework of the power supply company, ASECCA of consumers and sub-plants; implementation of a comprehensive Program of PLE reduction.

Implementation of project activities started in 2003, as provided for in the determined PDD, version 02. However, emission reductions generated in 2003 were conservatively excluded from the calculation. Therefore, 01/01/2004 was taken as a starting date of the crediting period.

Project implementation status in the reporting period of 01/01/2011 – 31/12/2011 is provided in the Table 2 below.



**Table 2 Status of project implementation during the monitoring period**

№	Measures	Number of units of work done in the period of 01/01/2011 – 31/12/2011 for each voltage class					
		0.38k V	6kV	10kV	35kV	110kV	154kV
1	Implementation of new or reconstruction of existing wires of cable electricity transmission lines, km	7.298	5.234	9.947	-	-	-
2	Replacement of insulators of electricity transmission lines, units	27272	-	4058	577	-	1264
3	Replacement of electricity meters, units	63053	117	130	41	-	12
4	Implementation of new or reconstruction of existing double-winding transformers, units	-	22	100	-	-	-
5	Implementation of new or reconstruction of existing wires of overhead electricity transmission lines, km	24.864 5	4.711	5.161	-	-	3.2

Status of project activity implementation during the appropriate monitoring period complies with the determined PDD version 02.

The verification team can confirm, through the visual inspection and document review that the JI project including data collecting and storage systems have been implemented according to the PDD.

The identified areas of concern as to the project implementation, project participants response and BVC's conclusion are described in Appendix A to this report (refer to CAR 02, CAR 03).



### **3.4 Compliance of the monitoring plan with the monitoring methodology (94-98)**

The monitoring occurred in accordance with the monitoring plan described in the PDD regarding which the determination has been deemed final and is so listed on the UNFCCC JI website.

For calculating the emission reductions, key factors, such as electricity losses due to absence of the introduction of new or reconstruction of existing wires of electricity transmission lines; electricity losses due to absence of the replacement of defected insulators of electricity transmission lines; electricity losses due to absence of the replacement of electricity meters; electricity losses due to absence of the implementation of reactive power compensation devices at consumer's site; electricity losses due to absence of the replacement of oil switches with vacuum and sulphur hexafluoride switches; electricity losses due to absence of the replacement or reconstruction of existing electric motors of power transformers blower cooling, etc., influencing the baseline emissions and the activity level of the project and the emissions as well as risks associated with the project were taken into account.

Data sources used for calculating emission reductions such as appropriately calibrated measuring devices (electricity meters), special institutional reporting forms 1B-TVE DAEK, official data on carbon dioxide emission factors for the Ukrainian power grid, etc., are clearly identified, reliable and transparent.

Emission factors, including default emission factors, are selected by carefully balancing accuracy and reasonableness, and appropriately justified of the choice.

The calculation of emission reductions is based on conservative assumptions and the most plausible scenarios in a transparent manner.

The identified areas of concern as to the compliance of the monitoring plan with the monitoring methodology, project participants response and BVC's conclusion are described in Appendix A to this report (refer to CAR 04, CAR 05, CAR 06, CAR 07, CAR 08, CL 01).

### **3.5 Revision of monitoring plan (99-100)**

Not applicable.


### **3.6 Data management (101)**

The data and their sources, provided in monitoring report, are clearly identified, reliable and transparent.

VERIFICATION REPORT

The implementation of data collection procedures is in accordance with the monitoring plan, including the quality control and quality assurance procedures.

The project monitoring is conducted according to standard operational practices established at PJSC "PC "Khersonoblenergo" within the framework of the existing data collection, accounting and reporting system. The scheme of data collection using automated system of electricity consumption commercial accounting (ASECCA) within the framework of the energy supply company is provided in Figure 8 of the Monitoring Report. Scheme of data collection prior to implementation of the automated system of electricity consumption commercial accounting (ASECCA) is shown in Figure 9 of the MR. Detailed operational and management structure of the project is presented below in Figure 1.

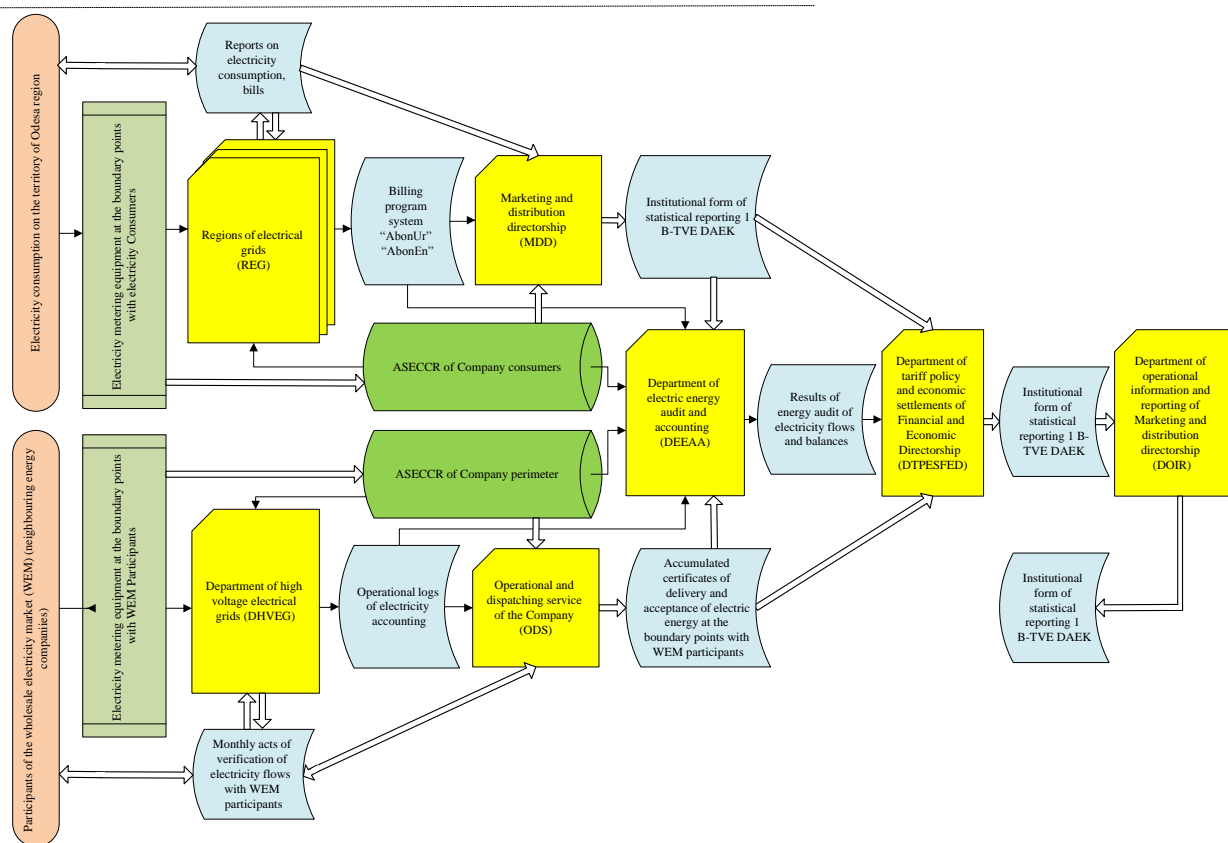

**Figure 1 Scheme of project management operational structure**

The function of the monitoring equipment, including its calibration status, is in order. The measurement equipment used for project monitoring is serviced, calibrated and maintained in accordance with the original manufacturer's instructions and industry standards; relevant records on measuring devices are kept as required. Staff of PJSC "PC



“Khersonoblenergo” regularly participate in scheduled inspections of electricity meters within the boundary of calculation accounting points joint with energy generating companies. List of measuring instruments used in the monitoring, is provided in Annex No. 3 to the Monitoring Report (Excel file).

The evidence and records used for the monitoring are maintained in a traceable manner. All necessary information for monitoring of GHGs emission reductions are stored in paper or/and electronic formats.

The data collection and management system for the project is in accordance with the monitoring plan.

The Monitoring Report provides sufficient information on the assigned roles, responsibilities and authorities for implementation and maintenance of monitoring procedures including control of data. The verification team confirms effectiveness of the existing management and operational systems and finds them eligible for reliable project monitoring.

The identified areas of concern as to the compliance of the monitoring plan with the monitoring methodology, project participants response and BVC’s conclusion are described in Appendix A to this report (refer to CAR 09, CAR 10, CAR 11, CL 02, CL 03).

### **3.7 Verification regarding programmes of activities (102-110)**

Not applicable.

## **4 VERIFICATION OPINION**

Bureau Veritas Certification has performed the second periodic verification for the period from January 1, 2011 to December 31, 2011 of the “Modernization of electric power distribution system at PJSC “PC “Khersonoblenergo” project, which applies JI specific approach. The verification was performed on the basis of UNFCCC criteria and host country criteria and also on the criteria given to provide for consistent project operations, monitoring and reporting.

The verification consisted of the following three phases: i) desk review of monitoring report against project design and the baseline and monitoring plan; ii) follow-up interviews with project stakeholders; iii) resolution of outstanding issues and the issuance of the final verification report and opinion.

The management of VEMA S.A. is responsible for the preparation of the GHG emissions data and the reported GHG emissions reductions of the project on the basis set out within the project Monitoring Plan indicated in the final PDD version 02. The development and maintenance of records



and reporting procedures are in accordance with that plan, including the calculation and determination of GHG emission reductions from the project, is the responsibility of the management of the project.

Bureau Veritas Certification verified the Project Monitoring Report, version 02, for the reporting period from 01/01/2011 to 31/12/2011 as indicated below. Bureau Veritas Certification confirms that the project is implemented as planned and described in approved project design documents. Installed equipment being essential for generating emission reduction runs reliably and is calibrated appropriately. The monitoring system is in place and the project is generating GHG emission reductions.

Bureau Veritas Certification can confirm that the GHG emission reduction is accurately calculated and is free of material errors, omissions, or misstatements. Our opinion relates to the project's GHG emissions and resulting GHG emissions reductions reported and related to the approved project baseline and monitoring, and its associated documents. Based on the information we have seen and evaluated, we confirm, with a reasonable level of assurance, the following statement:

Reporting period: From 01/01/2011 to 31/12/2011

Baseline emissions	: 1 165 968	tonnes of CO <sub>2</sub> equivalent.
Project emissions	: 501 880	tonnes of CO <sub>2</sub> equivalent.
Emission Reductions	: 664 088	tonnes of CO <sub>2</sub> equivalent.



## 5 REFERENCES

### Category 1 Documents:

Documents provided by the project participants that relate directly to the GHG components of the project.

/1/	Project Design Document of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo", version 02 dated 11/07/2011
/2/	Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period from 01/01/2011 to 31/12/2011 version 01 dated 13/02/2012
/3/	Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period from 01/01/2011 to 31/12/2011 version 02 dated 02/04/2012
/4/	Annex 1 to the Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2011-31/12/2011. "Implementation of new and reconstruction of existing elements of the electrical grid"
/5/	Annex 2 to the Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2011-31/12/2011. "Quantity of installed electrical equipment units"
/6/	Annex 3 to the Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2011-31/12/2011. "List of metering devices"
/7/	Annex 4 to the Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2011-31/12/2011. "Calculation of GHG emission reductions"
/8/	Package of accompanying documents No. 1 to the Monitoring Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2011-31/12/2011
/9/	Determination Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" No. UKRAINE-det/0268/2011, dated 08/07/2011 issued by Bureau Veritas Certification Holding SAS
/10/	Verification Report of the JI project "Modernization of electric power distribution system at PJSC "PC "Khersonoblenergo" for the period 01/01/2008 – 31/12/2010 issued by Bureau Veritas Certification Holding SAS as on 20/09/2011
/11/	Letter of Approval #2485/23/7 dated 12/09/2011 issued by the State Environmental Investment Agency of Ukraine



/12/	Letter of Approval # J294-0485 issued by the Federal Office for the Environment (FOEN) of Switzerland dated 28/06/2011
------	--

### Category 2 Documents:

Background documents related to the design and/or methodologies employed in the design or other reference documents.

/1/	"Guidance on criteria for baseline setting and monitoring", version 02, JISC
/2/	Order of the National Environmental Investment Agency of Ukraine (NEIA) No. 75 "On approval of carbon dioxide emission factors in 2011"
/3/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction of PL-0,4 kV from TP-189) dated 15/12/2011
/4/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction of PL-0,4 kV from ZTP № 042 F-1 Henichesk city, Vorovskoho St.) dated 02/11/2011
/5/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction of VL-0,4 kV from TP-16T Novovorontsovka, Boryslavska St., Novovorontsovka urban village, Novovorontsovka region, Kherson region) dated 13/12/2011
/6/	Maintenance work acceptance certificate № 101 dated 18/11/2011
/7/	Maintenance work acceptance certificate № 105 dated 30/11/2011
/8/	Maintenance work acceptance certificate № 107 dated 16/11/2011
/9/	Maintenance work acceptance certificate № 111 dated 30/12/2011
/10/	Maintenance work acceptance certificate № 109 dated 30/12/2011
/11/	Maintenance work acceptance certificate № 108 dated 29/12/2011
/12/	Maintenance work acceptance certificate № 93 dated 28/10/2011
/13/	Maintenance work acceptance certificate № 94 dated 25/10/2011
/14/	Maintenance work acceptance certificate № 95 dated 28/10/2011
/15/	Maintenance work acceptance certificate № 97 dated 26/10/2011
/16/	Maintenance work acceptance certificate № 2570 dated 25/05/2011
/17/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction VL-0,4 kV from KTP-332,478,606,899,1266,1267,1043,917 to 32 Morska St.)
/18/	Measuring devices replacement certificate and sealing certificate dated 12/01/2011



## VERIFICATION REPORT

/19/	Measuring devices replacement certificate and sealing certificate dated 02/08/2011
/20/	Measuring devices replacement certificate and sealing certificate dated 07/06/2011
/21/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (construction of KL-10 kV from high voltage room installed at RU – 10 kV I SSh PS 150/35/10 kV «HNS-KOS» to production base of “Hlobart” LLC in Kakhovslyi region, Liubymivka urban village, 3 Industrialna St.) dated 08/12/2011
/22/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (construction of KL-0,4 kV from RP-0,4 kV ZTP-9 to inlet-distribution customer device in Kakhovka city, 46 Kalinina St.) dated 31/10/2011
/23/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (capital construction of PL-0,4 kV from ZTP-27) dated 25/06/2011
/24/	Structure of balance of electricity and process losses in the course of electricity transmission in power grids of 154-0,38 kV of PJSC «PC «Khersonoblenergo» of South region in August 2011
/25/	Structure of balance of electricity and process losses in the course of electricity transmission in power grids of 154-0,38 kV of PJSC «PC «Khersonoblenergo» of South region in December 2011
/26/	Structure of balance of electricity and process losses in the course of electricity transmission in power grids of 154-0,38 kV of PJSC «PC «Khersonoblenergo» of South region in September 2011
/27/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 21/01/2011 (laying of cable of AVBShv 4x95 and AVBbShv 4x120 makrs from TP-1 to k.ya. zh/b in 182 Melitopolska St.; length is 0,28 km. Total length of KL-0,4 kV from TP-1 after reconstruction is 0,39 km)
/28/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 21/01/2011 (installation of z/b support SV 10,5-5 12 units. Southern cable of AS-50 mark. Laid cable of ASB2L-10 3x150 mark; length of 0,08 km. Length of reconstructed line is 0,33 km. Total length of VL-10 κB F-1701 after reconstruction is 12,107 km)
/29/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 21/01/2011 (laying of cable of AVBbShv 3x150+1x95 TP-610 mark to k.ya. zh/b in 84 Shovkunenka St.; length of 0,113 km. Total length of KL-0,4 kV from TP-619 after reconstruction is 0,26 km)
/30/	Acceptance certificate for repaired, reconstructed and modernized facilities





## VERIFICATION REPORT

	dated 17/07/2011 (installation of z/b support – 5 units. Southern cable of AsXSn 4x50 mark. Length of reconstructed section from TP-70 is 0,108 km. Total construction length of PL-0,4 kV from TP-70 after reconstruction is 3,629 km)
/31/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 30/01/2011 (installation of z/b support – 91 units. Southern cable of A-70, A-50, A-35, AsXSn 4x50 marks. Length of reconstructed section from KTP-347 is 4,159 km. Total construction length of PL-0,4 kV from TP-347 after reconstruction is 4,209 km)
/32/	Structure of balance of electricity and process losses in the course of electricity transmission in power grids of 154-0,38 kV of PJSC «PC «Khersonoblenergo» of South region in November 2011
/33/	Meter calibration protocol SAZU-I673M dated 25/07/2011
/34/	Meter calibration protocol SA4U- I672M dated 25/10/2011
/35/	Meter calibration protocol SO-I449M1 dated 28/11/2011
/36/	Meter calibration protocol SA4U- I672M dated 30/03/2011
/37/	Meter calibration protocol SA4U- I672M dated 31/03/2011
/38/	Structure of balance of electricity and process losses in the course of electricity transmission in power grids of 154-0,38 kV of PJSC «PC «Khersonoblenergo» of South region in October 2011
/39/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 05/12/2011 (installation of z/b support, SV 10,5-5 – 13 units. SV9,5-2 – 62 units. Southern cable of ASxSN 4x70 mm <sup>2</sup> , ASxSN 4x35 mm <sup>2</sup> , ASxSN 4x25mm <sup>2</sup> marks. Length of reconstructed section is 3,8 km)
/40/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 29/07/2011 (installation of support SV9.5-2 – 39 units. Southern cable of ASxSN 40x50, ASxSN 4x70 marks. Length of reconstructed section is 1,7 km)
/41/	Acceptance certificate for repaired, reconstructed and modernized facilities dated 31/01/2011 (laying of cable of ASB2L 3x150mm <sup>2</sup> mark from RU-6 kV to RU-6 kV of TP-427; length is 0,357 km)
/42/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction of VL 0,4 KTP-265 in Lazurne urban village of Skadovsk region, Lenina Str.)
/43/	Electricity meter replacement certificate and sealing certificate №1485 dated 21/03/2012
/44/	Electricity meter replacement certificate and sealing certificate №1464 dated 21/03/2012
/45/	Electricity meter replacement certificate and sealing certificate №1486 dated 21/03/2012
/46/	Electricity meter replacement certificate and sealing certificate №2932 dated



## VERIFICATION REPORT

	09/09/2011
/47/	Electricity meter replacement certificate and sealing certificate №1855 dated 30/03/2012
/48/	Commissioning certificate on power distribution grid facilities the estimated cost of which doesn't exceed 1 mln UAH, issued by working technical commission (reconstruction of VL-10 F-89 1 Hladovka, Tavriiske village, 472 a Lenina Str.)
/49/	Electricity meter replacement certificate and sealing certificate №1572 dated 19/05/2011

**Persons interviewed:**

List of persons interviewed during the verification or persons that contributed with other information that is not included in the documents listed above.

	<b>Name</b>	<b>Organization</b>	<b>Position</b>
/1/	Baklanov V.	PJSC «PC «Khersonoblenergo»	Deputy commercial director
/2/	Holinko M.	PJSC «PC «Khersonoblenergo»	Head of pofidernic analysis service
/3/	Hetmanov V.	PJSC «PC «Khersonoblenergo»	Technical director
/4/	Yurchenko Yu.	PJSC «PC «Khersonoblenergo»	Commercial director
/5/	Reshetniak S.	PJSC «PC «Khersonoblenergo»	Head of Sub-stations Service
/6/	Honcharuk V.	PJSC «PC «Khersonoblenergo»	Deputy technical director
/7/	Boiarchuk V.	PJSC «PC «Khersonoblenergo»	Head of team of operation and technical control central service
/8/	Palamarchuk D.	“CEP” LLC	Consultant of VEMA S.A.



## VERIFICATION REPORT

## APPENDIX A: COMPANY PROJECT VERIFICATION PROTOCOL

## BUREAU VERITAS CERTIFICATION HOLDING SAS

## JI PROJECT VERIFICATION PROTOCOL

Check list for verification, according to the JOINT IMPLEMENTATION DETERMINATION AND VERIFICATION MANUAL (Version 01)

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
<b>Project approvals by Parties involved</b>				
90	Has the NFPs of at least one Party involved, other than the host Party, issued a written project approval when submitting the first verification report to the secretariat for publication in accordance with paragraph 38 of the JI guidelines, at the latest?	<p>The project has been approved by both parties. The Letters of Approval were presented to the verification team.</p> <p><b>CAR 01.</b> The name of institution that issued the Letter of Approval from the party - buyer (Switzerland) is absent in Section A.2. Please, state the name of the institution.</p>	<b>CAR 01</b>	OK
91	Are all the written project approvals by Parties involved unconditional?	Yes, all the written project approvals by Parties involved are unconditional.	OK	OK
<b>Project implementation</b>				
92	Has the project been implemented in accordance with the PDD regarding which the determination has been deemed final and is so listed on the UNFCCC JI website?	<p>Yes, the project has been implemented in accordance with the PDD, which is listed on the UNFCCC JI website.</p> <p>The project scenario provides for implementation of new energy efficient equipment and a set of organizational and technical measures aimed at reduction of process losses of electricity.</p>	<b>CAR 02</b> <b>CAR 03</b>	OK OK



## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
		<p>122 transformers, 22.479 km of cable line wire, 33 171 insulators, 63 353 electricity meters and 37.9365 km of wire of overhead electricity transmission lines were implemented or reconstructed in the period from 01/01/2011 to 31/12/2011. Detailed information is provided in Annex 2 to the MR.</p> <p><b>CAR 02.</b> In Section A.6 of the MR, the number of installed equipment units is stated incorrectly. Please, check the conformity of Table 1 in the MR and Annex 2 and make appropriate corrections.</p> <p><b>CAR 03.</b> In Section A.3. of the MR, the list of activities planned under the project is not comprehensive. Please, provide a comprehensive list of project measures.</p>		
93	What is the status of operation of the project during the monitoring period?	The Project was operational during the whole monitoring period, which is from 01/01/2011 to 31/12/2011.	OK	OK
<b>Compliance with monitoring plan</b>				
94	Did the monitoring occur in accordance with the monitoring plan included in the PDD regarding which the determination has been deemed final and is so listed on the UNFCCC JI website?	<p>Yes, the monitoring was carried out in accordance with the monitoring plan included in the PDD regarding which the determination has been deemed final and is so listed on the UNFCCC JI website.</p> <p><b>CAR 04.</b> In Section A.5.1. of the MR it is stated that the dynamic baseline for this project was chosen according to a specific approach based on the requirements specified in paragraph 9 (a)</p>	<b>CAR 04</b> <b>CAR 05</b>	OK OK



VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
		<p>of the Guidance on criteria for baseline setting and monitoring, version 03, while in the final determined version of the PDD the Guidance Version 02 was used.</p> <p><b>CAR 05.</b> In Section A.5.2. of the MR, the name of the institution that approves the calculation of electricity process losses in distribution grids of Oblenero (NERC).</p>		
95 (a)	<p>For calculating the emission reductions or enhancements of net removals, were key factors, e.g. those listed in 23 (b) (i)-(vii) above, influencing the baseline emissions or net removals and the activity level of the project and the emissions or removals as well as risks associated with the project taken into account, as appropriate?</p>	<p>For calculating the emission reductions, key factors, such as electricity losses due to absence of the introduction of new or reconstruction of existing wires of electricity transmission lines; electricity losses due to absence of the replacement of defected insulators of electricity transmission lines; electricity losses due to absence of the replacement of electricity meters; electricity losses due to absence of the implementation of reactive power compensation devices at consumer's site; electricity losses due to absence of the replacement of oil switches with vacuum and sulphur hexafluoride switches; electricity losses due to absence of the replacement or reconstruction of existing electric motors of power transformers blower cooling, etc., influencing the baseline emissions and the activity level of the project and the emissions as well as risks associated with the project were taken into account.</p>	OK	OK



BUREAU  
VERITAS

## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
95 (b)	Are data sources used for calculating emission reductions or enhancements of net removals clearly identified, reliable and transparent?	Yes, data sources used for calculating emission reductions or enhancements of net removals are clearly identified, reliable and transparent. <b>CAR 06.</b> Please, state GHG baseline and project emissions as well as GHG emission reductions in tones of CO <sub>2</sub> equivalent. <b>CAR 07.</b> In Table 4 of Section B.2.2. the name of $\cos\varphi_{y,tran(3.1),i_1}^P$ parameter doesn't coincide with the name, specified in the description of formulae.	<b>CAR 06</b> <b>CAR 07</b>	OK OK
95 (c)	Are emission factors, including default emission factors, if used for calculating the emission reductions or enhancements of net removals, selected by carefully balancing accuracy and reasonableness, and appropriately justified of the choice?	Yes, emission factors, including default emission factors, that were used for calculating the emission reductions or enhancements of net removals, were selected by carefully balancing accuracy and reasonableness, and appropriately justified of the choice.	OK	OK
95 (d)	Is the calculation of emission reductions or enhancements of net removals based on conservative assumptions and the most plausible scenarios in a transparent manner?	Calculation of emission reductions is based on conservative assumptions and the most plausible scenarios in a transparent manner. <b>CAR 08.</b> Please, in Section E.4. specify how GHG emission reductions are calculated. <b>CL 01.</b> Please, explain why there is the difference between the emission reductions specified in the MR and the emission reductions stated in the PDD.	<b>CAR 08</b> <b>CL 01</b>	OK OK
<b>Applicable to JI SSC projects only</b>				



**BUREAU  
VERITAS**

## VERIFICATION REPORT

<b>DVM Paragraph</b>	<b>Check Item</b>	<b>Initial finding</b>	<b>Draft Conclusion</b>	<b>Final Conclusion</b>
96	Is the relevant threshold to be classified as JI SSC project not exceeded during the monitoring period on an annual average basis? If the threshold is exceeded, is the maximum emission reduction level estimated in the PDD for the JI SSC project or the bundle for the monitoring period determined?	N/a	N/a	N/a
<b>Applicable to bundled JI SSC projects only</b>				
97 (a)	Has the composition of the bundle not changed from that is stated in F-JI-SSCBUNDLE?	N/a	N/a	N/a
97 (b)	If the determination was conducted on the basis of an overall monitoring plan, have the project participants submitted a common monitoring report?	N/a	N/a	N/a
98	If the monitoring is based on a monitoring plan that provides for overlapping monitoring periods, are the monitoring periods per component of the project clearly specified in the monitoring report? Do the monitoring periods not overlap with those for which verifications were already deemed final in the past?	N/a	N/a	N/a
<b>Revision of monitoring plan</b>				
<b>Applicable only if monitoring plan is revised by project participant</b>				
99 (a)	Did the project participants provide an appropriate justification for the proposed	N/a	N/a	N/a



**BUREAU  
VERITAS**

## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
	revision?			
99 (b)	Does the proposed revision improve the accuracy and/or applicability of information collected compared to the original monitoring plan without changing conformity with the relevant rules and regulations for the establishment of monitoring plans?	N/a	N/a	N/a
<b>Data management</b>				
101 (a)	Is the implementation of data collection procedures in accordance with the monitoring plan, including the quality control and quality assurance procedures?	<b>CAR 09.</b> Please, provide sketchy description of the project management procedures. <b>CL 02.</b> Please, provide information on collection of data from meters at sub-stations that were not equipped with ASECCA.	<b>CAR 09</b> <b>CL 02</b>	OK OK
101 (b)	Is the function of the monitoring equipment, including its calibration status, is in order?	Yes, the function of the monitoring equipment, including its calibration status is in order.  <b>CAR 10.</b> Please, in the MR provide information on the calibration frequency of measuring equipment that is involved in the monitoring. <b>CAR 11.</b> Please, provide information on persons/entities that execute calibration of measuring equipment at the company.	<b>CAR 10</b> <b>CAR 11</b>	OK OK
101 (c)	Are the evidence and records used for the monitoring maintained in a traceable manner?	Yes, the evidence and records used for the monitoring are maintained in a traceable manner	OK	OK
101 (d)	Is the data collection and management system for the project in accordance with the monitoring plan?	The data collection and management system of the project is in accordance with the monitoring plan.	<b>CL 03</b>	OK





## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
		Verification team confirms the effectiveness of existing management system and operating system and considers them to be suitable for reliable monitoring of the project. <b>CL 03.</b> Please check the numbering of tables and Figures in the MR.		
<b>Verification regarding programs of activities (additional elements for assessment)</b>				
102	Is any JPA that has not been added to the JI PoA not verified?	N/a	N/a	N/a
103	Is the verification based on the monitoring reports of all JPAs to be verified?	N/a	N/a	N/a
103	Does the verification ensure the accuracy and conservativeness of the emission reductions or enhancements of removals generated by each JPA?	N/a	N/a	N/a
104	Does the monitoring period not overlap with previous monitoring periods?	N/a	N/a	N/a
105	If the AIE learns of an erroneously included JPA, has the AIE informed the JISC of its findings in writing?	N/a	N/a	N/a
<b>Applicable to sample-based approach only</b>				
106	Does the sampling plan prepared by the AIE: (a) Describe its sample selection, taking into account that: (i) For each verification that uses a sample-based approach, the sample	N/a	N/a	N/a



## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
	<p>selection shall be sufficiently representative of the JPAs in the JI Project. Such extrapolation to all JPAs identified for that verification is reasonable, taking into account differences among the characteristics of JPAs, such as:</p> <ul style="list-style-type: none"> <li>- The types of JPAs;</li> <li>- The complexity of the applicable technologies and/or measures used;</li> <li>- The geographical location of each JPA;</li> <li>- The amounts of expected emission reductions of the JPAs being verified;</li> <li>- The number of JPAs for which emission reductions are being verified;</li> <li>- The length of monitoring periods of the JPAs being verified; and</li> <li>- The samples selected for prior verifications, if any?</li> </ul>			
107	Is the sampling plan ready for publication through the secretariat along with the verification report and supporting documentation?	N/a	N/a	N/a
108	Has the AIE made site inspections of at least the square root of the number of total JPAs, rounded to the upper whole number? If the AIE makes no site	N/a	N/a	N/a



BUREAU  
VERITAS

## VERIFICATION REPORT

DVM Paragraph	Check Item	Initial finding	Draft Conclusion	Final Conclusion
	inspections or fewer site inspections than the square root of the number of total JPAs, rounded to the upper whole number, then does the AIE provide a reasonable explanation and justification?			
109	Is the sampling plan available for submission to the secretariat for the JISC.s ex ante assessment? (Optional)	N/a	N/a	N/a
110	If the AIE learns of a fraudulently included JPA, a fraudulently monitored JPA or an inflated number of emission reductions claimed in a JI PoA, has the AIE informed the JISC of the fraud in writing?	N/a	N/a	N/a



## VERIFICATION REPORT

**TABLE 2 RESOLUTION OF CLARIFICATION AND CORRECTIVE ACTION REQUESTS**

<b>Clarification and corrective action requests issued by the verification team</b>	<b>Ref to checklist question in Table 1</b>	<b>Summary of project participant's response</b>	<b>Verification team conclusion</b>
<b>CAR 01.</b> The name of institution that issued the Letter of Approval from the party - buyer (Switzerland) is absent in Section A.2. Please, state the name of the institution.	90	The Letter of Approval from Switzerland No. J294-0485 was issued by the Federal Office for the Environment (FOEN) as on 28/06/2011.	The issue is closed based on necessary corrections made.
<b>CAR 02.</b> In Section A.6 of the MR, the number of installed equipment units is stated incorrectly. Please, check the conformity of Table 1 in the MR and Annex 2 and make appropriate corrections.	92	Data relating to the number of installed equipment units were verified. Necessary corrections were made in the latest version of the MR.	The issue is closed based on necessary corrections made.



BUREAU  
VERITAS

## VERIFICATION REPORT

<p><b>CAR 03.</b> In Section A.3. of the MR, the list of activities planned under the project is not comprehensive. Please, provide a comprehensive list of project measures.</p>	92	<p>The list of these measures is provided below:</p> <ul style="list-style-type: none"> <li>- modernization works and implementation of new energy efficient equipment;</li> <li>- improvement of the reliability of electricity supply;</li> <li>- introduction of automated system of electricity consumption commercial accounting (ASECCA) within the framework of the power supply company, ASECCA of consumers and sub-plants;</li> <li>- implementation of a comprehensive Program of PLE reduction.</li> </ul>	<p>The issue is closed based on provision of necessary information in the MR version 02.</p>
<p><b>CAR 04.</b> In Section A.5.1. of the MR it is stated that the dynamic baseline for this project was chosen according to a specific approach based on the requirements specified in paragraph 9 (a) of the Guidance on criteria for baseline setting and monitoring, version 03, while in the final determined version of the PDD the Guidance Version 02 was used.</p>	94	<p>Necessary corrections were made in the latest version of the MR.</p>	<p>Necessary corrections were made in the MR version 02. The issue is closed.</p>
<p><b>CAR 05.</b> In Section A.5.2. of the MR, the name of the institution that approves the calculation of electricity process losses in distribution grids of Oblenero (NERC).</p>	94	<p>The calculation of electricity process losses in distribution grids of Oblenero is accorded with the Ministry of Energy and Coal Industry of Ukraine and approved by the National Electricity Regulatory Commission (NERC).</p>	<p>The issue is closed based on necessary corrections made.</p>



BUREAU  
VERITAS

## VERIFICATION REPORT

<b>CAR 06.</b> Please, state GHG baseline and project emissions as well as GHG emission reductions in tones of CO <sub>2</sub> equivalent.	95 (b)	Necessary corrections were made in the MR version 02.	The issue is closed based on necessary changes made.
<b>CAR 07.</b> In Table 4 of Section B.2.2. the name of $\cos\varphi_{y,tran(3.1),i_1}^P$ parameter doesn't coincide with the name, specified in the description of formulae.	95 (b)	$\cos\varphi_{y,tran(3.1),i_1}^P$ - cosine of angle between active and full power in three-winding transformer "I <sub>1</sub> " of high voltage.	The issue is closed based on necessary changes made.
<b>CAR 08.</b> Please, in Section E.4. specify how GHG emission reductions are calculated.	95 (d)	GHG emission reductions resulting from the project implementation are calculated as the difference between the baseline and the project emissions. Relevant information is presented in Section E.4 of the MR version 02.	The issue is closed based on provision of necessary information.
<b>CAR 09.</b> Please, provide sketchy description of the project management procedures.	101 (a)	Sketchy description of the project management procedures is shown in Figure 7 in Section C.1 of the MR version 02.	The issue is closed based on provision of necessary information.
<b>CAR 10.</b> Please, in the MR provide information on the calibration frequency of measuring equipment that is involved in the monitoring.	101 (a)	Information on the calibration frequency of measuring equipment that is involved in the monitoring is provided in Table 2 of the MR version 2 and in Annex 3.	The issue is closed based on information presented in the MR version 02.
<b>CAR 11.</b> Please, provide information on persons/entities that execute calibration of measuring equipment at the company.	101 (b)	Kherson center for standardization, metrology and certification was involved in calibration of measuring equipment used in the project. Refer to Section C.3. in the latest version of the MR.	Information was provided, the issue is closed.



BUREAU  
VERITAS

## VERIFICATION REPORT

<p><b>CL 01.</b> Please, explain why there is the difference between the emission reductions specified in the MR and the emission reductions stated in the PDD.</p>	101 (a)	<p>The actual emission reductions during the monitoring period are slightly different from the values, which were stated in the determined PDD version 02. This is due to the fact that at the PDD development stage it was impossible to accurately determine the duration of operation of the electrical equipment per year and the number of days when electrical equipment operated in conditions of temperature below 5 °C. So predicted values were provided. The difference between planned and actual values of these parameters also caused differences in the amount of estimated and actually received emission reductions under the project.</p>	<p>The issue is closed based on provided clarification.</p>
<p><b>CL 02.</b> Please, provide information on collection of data from meters at sub-stations that were not equipped with ASECCA.</p>	101 (a)	<p>At sub-stations not equipped with ASECCA, in the monitoring period, data collection was mainly performed manually by on-duty personnel; then the data were transferred by phone to the head office of the energy system (hereinafter - the EU) for further calculations. For more information, see. Figure 9 in the MR "Scheme of data collection through operational information complex (OIC)"</p>	<p>The issue is closed based on provided information.</p>
<p><b>CL 03.</b> Please check the numbering of tables and Figures in the MR.</p>	101 (d)	<p>The numbering of Tables and Figures was reviewed. Appropriate corrections were made in the latest version of the MR.</p>	<p>The issue is closed based on changes made.</p>