

JI Project

**Nitrous Oxide Emission Reduction Project at GP
Nitric Acid Plant in AB Achema
Fertilizer Factory**

MONITORING REPORT

SECOND PROJECT CAMPAIGN

Monitoring period: from 25/01/2010 to 16/06/2011

Version 2.0

August 2011

TABLE OF CONTENTS

INTRODUCTION	3
REFERENCE.....	3
1. DESCRIPTION OF THE PROJECT ACTIVITY	4
1.1. Brief description, registration date and related information	4
1.2. Project participants.....	4
1.3. Location of the project activity	5
1.4. Project boundary	5
1.5. Technical description of the project.....	6
2. DESCRIPTION OF THE MONITORING AND DATA PROCESSING SYSTEMS	8
2.1. Monitoring system	8
2.2. Data processing system.....	11
3. EVALUATION OF THE MONITORING DATA	13
3.1. Data and parameters monitored	13
3.2. Methodology	14
3.3. Data correction.....	16
3.4. Campaign length	16
3.5. Impact of regulations	16
4. MONITORING RESULTS	18
4.1. Results of the baseline campaign calculations	18
4.2. Results of the project campaign calculations	19
5. EMISSION REDUCTION CALCULATIONS	20
5.1. Baseline emissions	20
5.2. Project emissions	20
5.3. Illustration of emission reduction calculations	20
5.4. Remarks	20
Annex I – AM0034 configuration with 2008 QAL2	22
Annex II – AM0034 configuration with 2010 QAL2	23
Annex III – Scheme of responsibilities.....	24

INTRODUCTION

The purpose of the Joint Implementation project “Nitrous Oxide Emission Reduction Project at GP Nitric Acid Plant in AB Achema Fertilizer Factory” (hereinafter – the Project) is to reduce N₂O emissions from Achema GP nitric acid production plant by using secondary catalyst that converts N₂O into Oxygen (O₂) and Nitrogen (N₂). When implementing the Project there is no cause for greenhouse gas (hereinafter – GHG) emissions.

The Project started to be carried out by installing the secondary catalyst in August 2008. This monitoring report (hereinafter – the Report) covers the period of the second project campaign, when emissions have been monitored during the period from January 25, 2010 till June 16, 2011.

The Report contains information on emission reductions during above mentioned period and reviews steps, implemented in accordance with the Monitoring plan and the requirements of the CDM methodology AM0034 “Catalyst reduction of N₂O inside the ammonia burner of nitric acid plants” v02.

REFERENCE

- Approved baseline and monitoring methodology: CDM methodology AM0034 “Catalyst reduction of N₂O inside the ammonia burner of nitric acid plants” v02, available at <http://cdm.unfccc.int/methodologies/DB/993RRDBB2WJI9TAD2XCKPK5YATQXY6>.
- Determination of the JI-project ”Nitrous Oxide Emission Reduction Project at GP Nitric Acid Plant in AB Achema Fertilizer Factory”. Report No. 1029455.
- JI Manual for GP Plant (V2.0 2010-01-22).
- Project Design Document “Nitrous Oxide Emission Reduction Project at GP Nitric Acid Plant in AB Achema Fertilizer Factory”.

1. DESCRIPTION OF THE PROJECT ACTIVITY

1.1. Brief description, registration date and related information

Project activity:	“Nitrous Oxide Emission Reduction Project at GP Nitric Acid Plant in AB Achema Fertilizer Factory, Lithuania”
UNFCCC registration number:	0064 (ITL-ID: LT2000005)
Project Participants:	AB ACHEMA
Location of the project:	Jonalaukis village, Rukla county, Jonava region municipality, Lithuania
Date of registration:	July 8, 2008 (date of Letter of Approval (LoA) issued by Host Party)
Starting date of the crediting period	August 16, 2008 (1 st project campaign)
Project campaigns	16/08/2008 – 26/09/2009 (1st Project campaign) 25/01/2010 – 16/06/2011 (2nd Project campaign)

BASF technology of catalytic destruction is used for reducing N₂O emissions from Achema GP nitric acid production plant by using secondary catalyst technology that converts N₂O into Oxygen (O₂) and Nitrogen (N₂). With this technology there is no cause for GHG emissions.

In order to calculate N₂O emission reductions from the project, ABB continuous multi-component measuring system Advance Cemas-NDIR is installed and operated.

1.2. Project participants

Host party – Lithuania

Legal entity, participating in the project - AB Achema

The Party involved does not wish to be considered as project participant.

AB Achema is a leading manufacturer of nitrogen fertilizers and chemical products in Lithuania and the Baltics. The company numbers over 1.4 thousand employees and annual fertilizer production is about 2 million tons. The plant production list consists of various items, such as nitrogen and compound fertilizers, adhesives, paints, resins, industrial gases, other chemical products and intermediates.

1.3. Location of the project activity

The Project is implemented in the territory of the AB Achema fertilizer factory, which is located in the central part of Lithuania near the Jonava town. The closest city Kaunas is situated about 30km southwest from Jonava. Geographic coordinates of the factory site centre are: $x=6105343$ $y=521432$.



Figure 1. Geographical location of AB Achema fertilizer plant

1.4. Project boundary

The project boundary of the Project sets the limits of the Project from the perspective of calculating the emission reductions attributable to the project. Hence the project boundaries include all anthropogenic emissions by sources of GHG under control of the project participants.

N₂O emissions are the only attribute to the GHG source within the Project boundary. They are presented below:

Table 1. GHG source in the Project boundary

	Source	Gas	Included / excluded	Justification / Explanation
Baseline	Nitric Acid Plant (Burner Inlet to Stack)	CO ₂	Excluded	The Project does not lead to any change in CO ₂ or CH ₄ emissions, therefore, these are not included
		CH ₄	Excluded	
		N ₂ O	Included	
Project Activity	Nitric Acid Plant (Burner Intel to Stack)	CO ₂	Excluded	The Project does not lead to any change in CO ₂ or CH ₄ emissions
		CH ₄	Excluded	
		N ₂ O	Included	
	Leakage emissions from production, transport, operation and decommissioning of the catalyst.	C ₂ O	Excluded	No leakage emissions are expected
		CH ₄	Excluded	
		N ₂ O	Excluded	

Project boundary covers entire GP plant, the diagram of it is presented bellow:

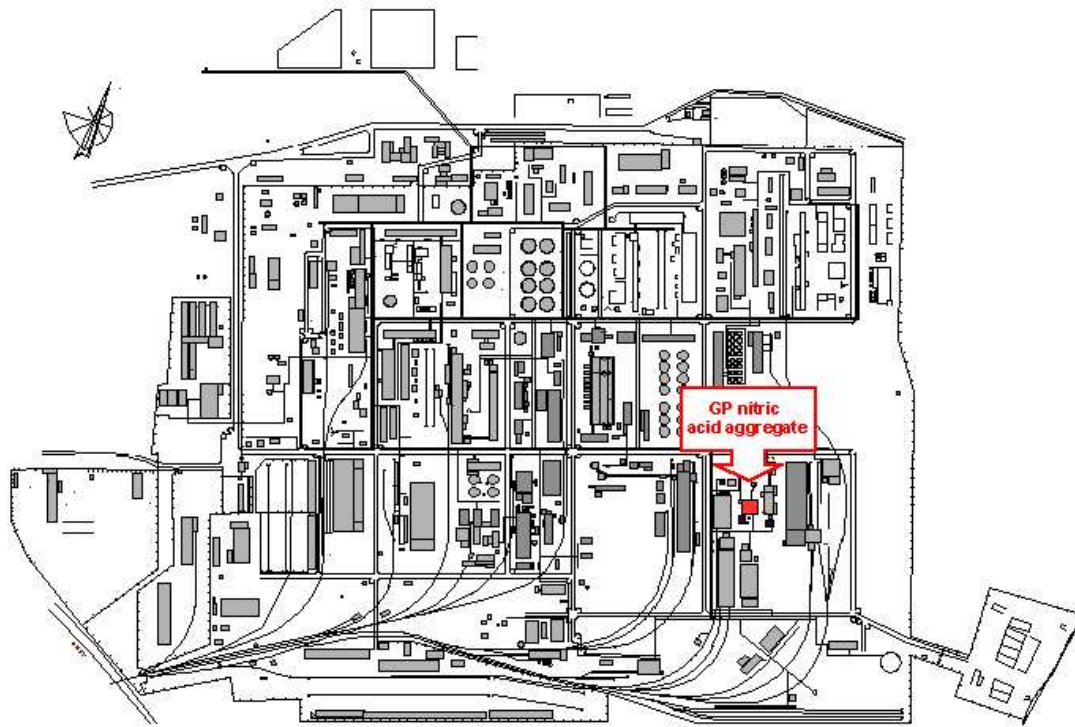


Figure 2. Location of the GP nitric acid plant within the fertilizer factory

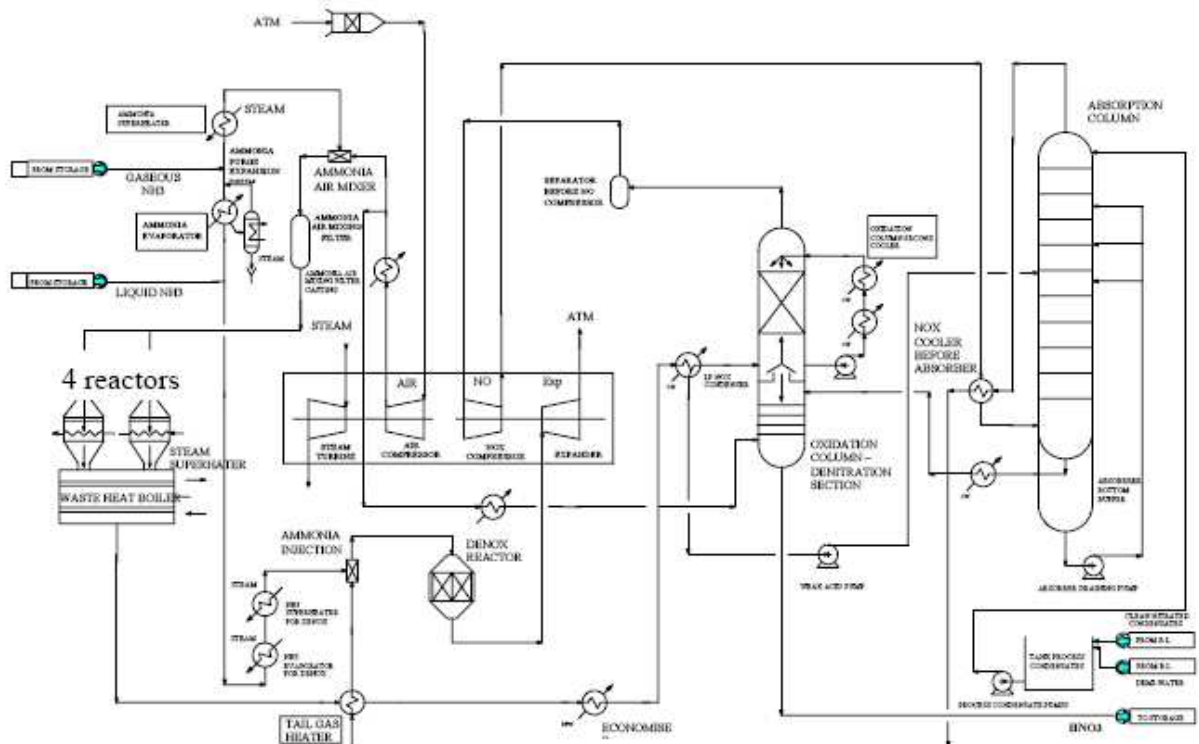


Figure 3. Nitric acid production scheme at GP plant

1.5. Technical description of the project

During the nitric acid (HNO_3) production process in nitric acid production plants, Nitrous Oxide (N_2O) is formed as a by product.

In order to produce nitric acid, ammonia (NH_3) is oxidized in a reactor with the precious metal (platinum-rhodium) catalyst gauzes into NO – desired product. NO then is oxidized to NO_2 which is absorbed in water to form HNO_3 . N_2O , formed during the process is emitted to the atmosphere as a tail gas.

N_2O emissions reductions in GP nitric acid production aggregate are achieved by using secondary catalyst technology that converts N_2O into Oxygen (O_2) and Nitrogen (N_2). BASF technology is applied by introducing a new catalyst bed which is installed in a new basket, directly under Platinum gauze in the nitric acid reactors. The technology is owned and patented by BASF (German patent BASF Catalyst 03-85).

The secondary catalyst (on Al_2O_3 basis with active metal oxides CuO and ZnO) is installed underneath the platinum gauze. In order to be able to install a secondary catalyst before the first Project campaign, the reconstruction of a burner basket was been performed to make required 20-100 mm additional free space under the Platinum gauze.

The installation of the new basket, the secondary catalyst and the test of GP plant operation were successfully performed by August 17, 2008 before the plant started operating for the first project campaign.

At the end of the design operating life of primary catalyst gauze, the nitric acid plant was shut down. The primary catalyst was replaced by a new primary catalyst (new gauze pack). For the second project campaign the plant started to operate on January 25, 2010 and was stopped on June 16 at 22:00, 2011.

The lifetime of the secondary catalyst is about 3 campaigns (lifetime of the platinum gauze), i.e. length of a campaign about 330 days in the high-pressure nitric acid reactors and about 1000 days in the medium-pressure nitric acid reactors. The guaranteed efficiency of the BASF secondary catalyst was about 80%. The average efficiency has reached up to 88 % during first project campaign and up to 84 % during the second project campaign.

2. DESCRIPTION OF THE MONITORING AND DATA PROCESSING SYSTEMS

2.1. Monitoring system

The N₂O monitoring system is designed according to the requirements set in the approved CDM baseline methodology AM0034.

Baseline emissions were monitored and calculated by continuous multi-component measuring system Advance Cemas-NDIR manufactured by ABB, prior to installation of secondary catalysts. The monitoring system allows to measure N₂O concentration in the tail gas flow continuously during the entire lifespan of the primary catalysts in the oxidation reactor.

The monitoring system was installed, adjusted and launched on 30th June 2007 at the end of the campaign IV. Campaign V (baseline campaign) was launched on 5th September 2007. Emissions were monitored during the entire baseline campaign after which, a secondary catalyst was installed and the first project campaign (VI) was launched. This is the second project campaign (VII).

Monitoring results of the baseline campaign give an average value of N₂O emissions released to the atmosphere while producing 1 t of HNO₃ without abatement technique. After the installation of the secondary catalyst, the baseline emissions were compared to the actual emissions that were also continuously measured. The difference between baseline emissions and actual emissions after the installation of the secondary catalyst give emission reduction values.

Location of sampling probes for on-line measurement of tail gas volume flow, temperature, pressure and N₂O concentration with ABB multi-component measuring system at GP nitric acid plant are shown in a Figure 4.

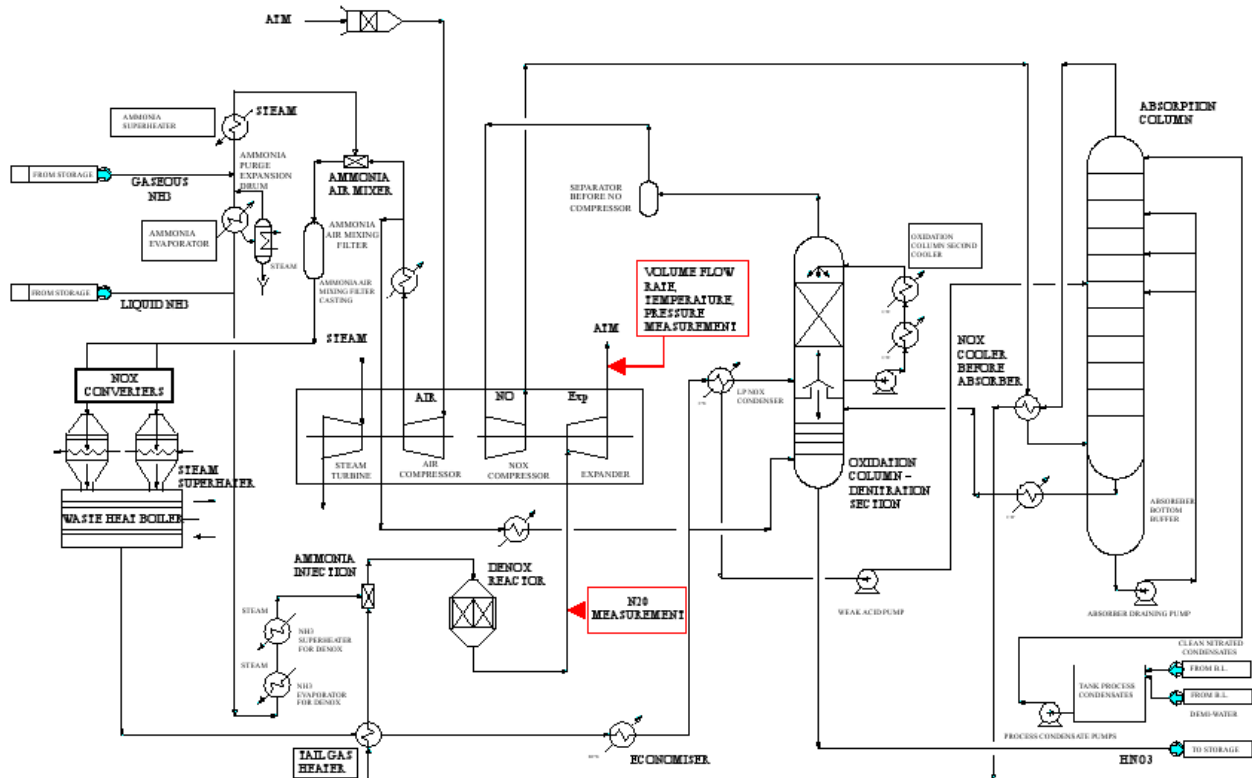


Figure 4. Sampling points for N₂O monitoring at GP plant

As it can be seen on the process scheme above, the volume flow, temperature and pressure measuring probe is installed after expander unit and N₂O sampling probe directly after DeNOx reactor.

Flow volume, temperature and pressure of the tail gas are measured separately from N₂O because length of straight duct at the N₂O sampling point is not long enough according to requirements for such measurements.

The N₂O monitoring system at GP plant consists of the following components:

- N₂O analyzer AO-2000-URAS-26 (ABB),
- Flow meter DELTAFLOW (Systec),
- Data Server EMI 3000,
- Distributed control system (DCS).

A simplified scheme of the monitoring system is presented below:

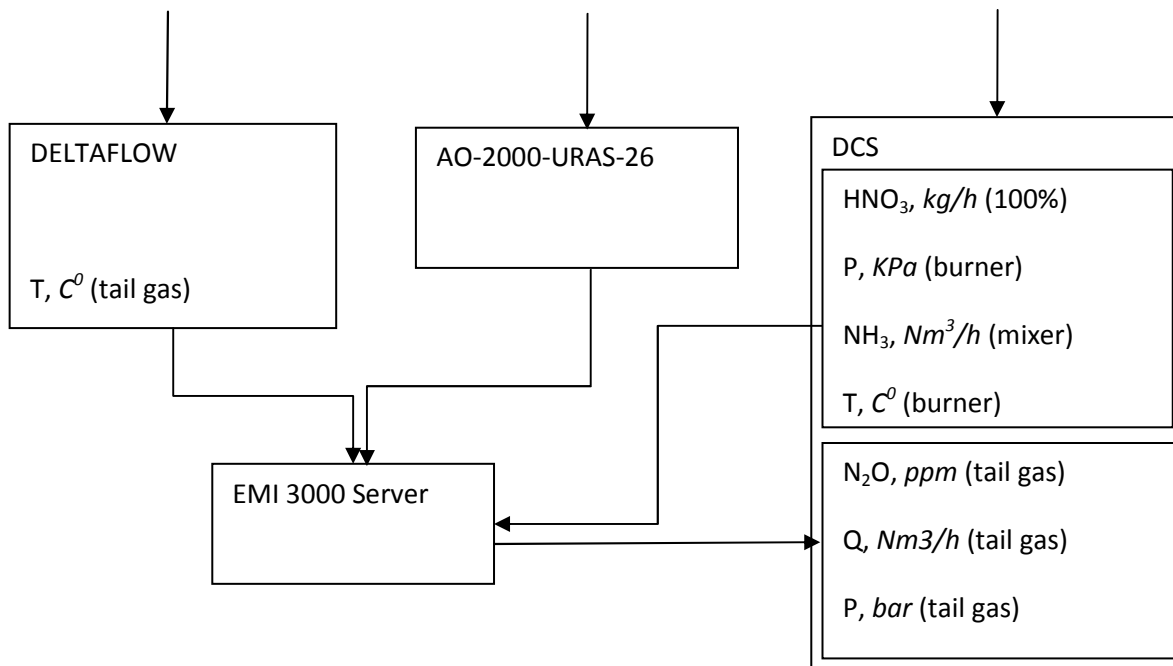


Figure 5. Automated monitoring system at GP plant

A flow meter measures volume flow (m^3/h), temperature and pressure in the tail gas and sends signals to the server. The server stores data and forwards signal to the Distributed Control System (DCS). The N_2O analyzer continuously measures concentration of N_2O in the tail gas and also sends signal to the data server which forwards it to DCS.

The AM0034 methodology requires monitoring scheme to be installed according to the European Norm 14181 (2004). The Norm requires evaluation of the automated measuring system (AMS) against three Quality Assurance Levels (QAL1, QAL2 and QAL3) and an Annual Surveillance Test (AST). Besides that, it must be ensured that the automated measuring system (AMS) is installed in accordance with the relevant European/international standards and manufacturer requirements and functional test is performed at the commissioning of the AMS.

QAL1 procedure requires compliance of the equipment with EN ISO 14956. AO-2000-URAS-26 and DELTAFLOW are ISO 14956 certified by the manufacturers.

QAL2 procedure requires determination of the calibration function and a test of the measured values of the AMS compared with the uncertainty given by legislation. During the maintenance period of the GP plant the openings required for QAL2 tests need to be made in the duct. QAL2 procedure is performed by an accredited independent entity.

QAL3 is a procedure to check drift and precision in order to demonstrate that the AMS is in control during its operation so that it continues to function within the required specifications for uncertainty. QAL3 is performed automatically as the system calibrates itself once a week. In addition, Achema's experts perform maintenance of the equipment such as fixing faults, changing filters, removing condensate from the system etc.

AST is a procedure to evaluate whether the measured values obtained from the AMS still meet the required uncertainty criteria – as demonstrated in the previous QAL2 test. AST is set to be performed annually by a selected validator. According to the European Norm 14181, AST was

performed for analyser by AIRTEC (ISO 17025 certified lab) from August 30 to September 1, 2010.

From August 30 to September 1, 2010, QAL2 tests were performed for volume flow, pressure and temperature after the change of the measuring equipment of stack gas volume flow in June 10, 2010. The tests results were adjusted into the system respectively.

The AM0034 requires determining the normal ranges for operating conditions for the following parameters: (i) oxidation temperature; (ii) oxidation pressure; (iii) ammonia gas flow rate, and (iv) air input flow rates. To calculate the “permitted range” for oxidation temperature and pressure, a historical data method was chosen and the permitted range then was entered into the AMS. The oxidation temperatures OT from all 4 reactors were included into the calculations. OT values of reactor No.1. were taken from EMI3000 system while OT values of reactors No.2, No.3, and No.4. were taken from DCS (Foxboro). N₂O values outside normal operating conditions i.e. outside OT permitted range presented in the PDD were eliminated.

2.2. Data processing system

The data processing system consists of the following components:

- Data logger CX1000
- Data server EMI3000
- External Backup harddrive
- Software CDMN2O

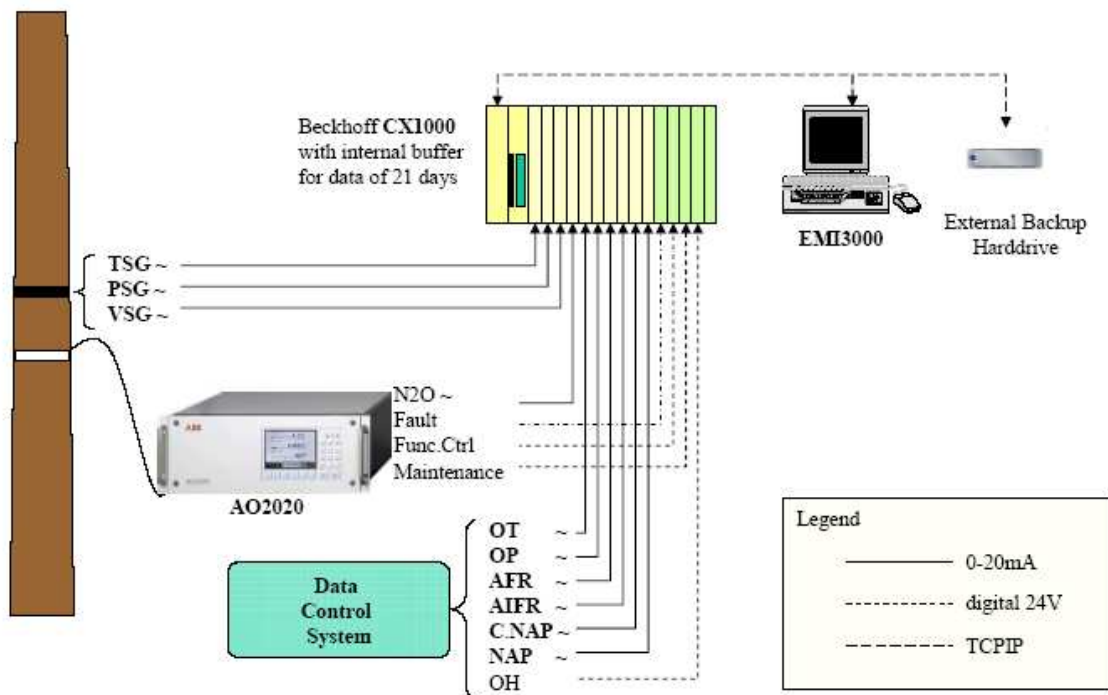


Figure 6. Data processing system

The Data logger CX1000 continuously reads and stores digital data of the monitoring system while EMI3000 handles the communication with the datalogger and continuously evaluates physical

second values with status information. Based on this second values 60-minutes averages with status information are calculated. All data are stored in a MySql-database and thus available for further evaluation. It is also backed up in the external hard drive disc.

Emission calculations are performed by CDMN2O (Version 1.0) software of AFRISO which allows to evaluate data according to the requirements of the approved CDM baseline methodology AM0034. The software is installed on the same PC running EMI3000 and is accessing its database. The software's compliance with AM0034 requirements has been verified and approved. EMI3000 and CDMN2O are operated by a responsible engineer of AB Achema while weekly maintenance and additional services related to the software are provided by AFRISO-EURO-INDEX GmbH.

All additional adjustments required by AM0034 and a verifier are performed manually in the excel sheets. The calculation files also serve as a basis for crosscheck of the monitoring accuracy.

Data processing system follows the methodology of the AM0034 and the monitoring plan, therefore only the final results as output of the system are presented in this report.

3. EVALUATION OF THE MONITORING DATA

3.1. Data and parameters monitored

According to the Monitoring plan these parameters have been monitored and archived by EMI3000, and transferred to CDMN2O programme:

OH [s] Operating Hours - derived from Digital Input „In Operation“

OT [°C] Oxidation Temperature

OP [kPa] Oxidation Pressure

AFR [kg/h] Ammonia Flow

AIFR [%] Ammonia/Air-Ratio

PSG [hPa] Pressure of stack gas

TSG [°C] Temperature of stack gas

VSG, oc [m³/h] Volume Flow rate of the stack gas insitu

VSG, norm [Nm³/h] Volume Flow rate of the stack gas (normalized)

NCSG[L] [mg/m³] N₂O concentration in tail gas Low Range

#NCSG[L] [s] N₂O Low Range: Valid Counter = incremented if in Low Range and valid

NCSG[H] [mg/m³] N₂O concentration in tail gas High Range

#NCSG[H] [s] N₂O High Range: Valid Counter = incremented if in high Range and valid

NCSG [mg/m³] N₂O concentration in tail gas

C(NAP) [%] Concentration of HNO₃

NAP (op) [t/h] HNO₃-Production

NAP [t/h] HNO₃-Production at 100%-conc. = C(NAP) * NAP.(op)

Mass rate of the N₂O flow is automatically calculated from the data of N₂O concentration in the tail gas and from its flow rate. The calculation is executed automatically in the EMI3000, where the calculated data is stored and archived. All required calculations are performed manually in excel sheets and are archived for the future reference.

In order to further ensure that operating conditions during the baseline campaign are representative of normal operating conditions, statistical tests have been performed to compare the average values of the permitted operating conditions with the average values obtained during the baseline determination period (comparisons are provided in the excel file "Statistical tests_V.1.0."). No differences in values are found, so the baseline determination should not be repeated.

3.2. Methodology

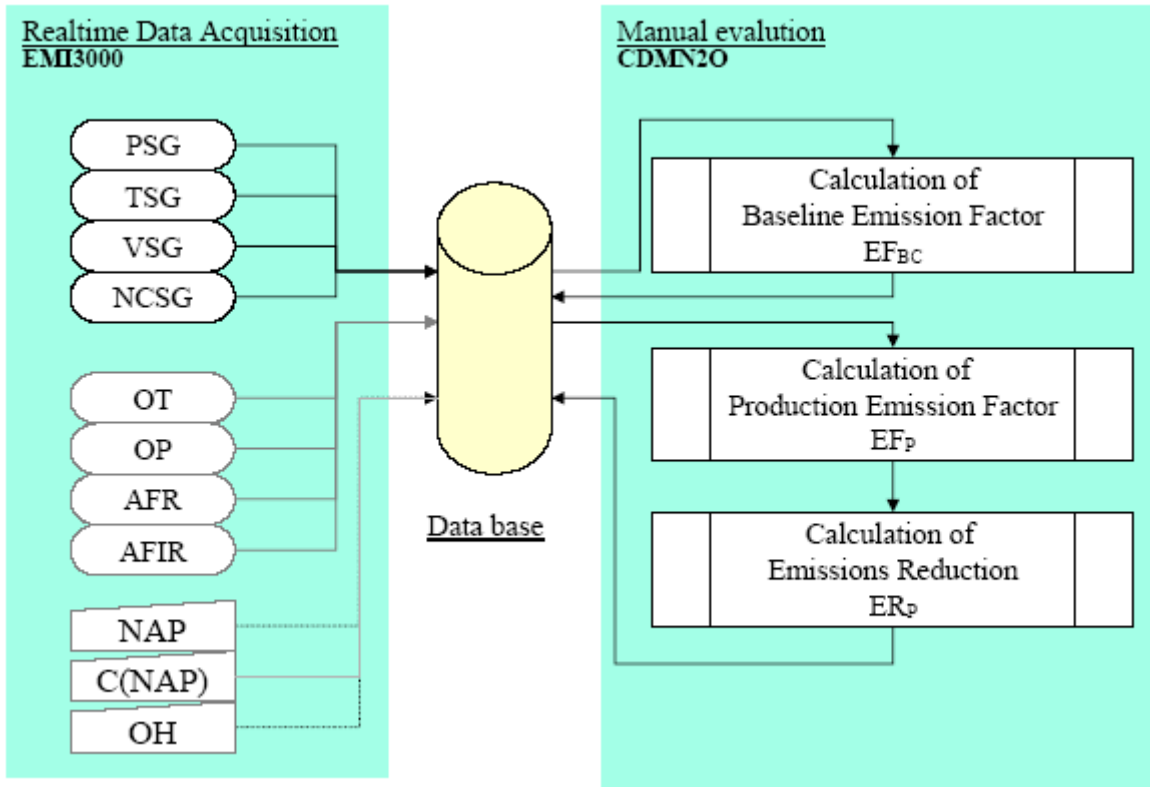


Figure 7. Data evaluation process

General evaluation rules are as follows:

- values for VSG, NCSG when OT, OP, AFR, AIFR inside permitted range:
 $OT_{min} < OTh < OT_{max}$
 $OP_{min} < OPh < OP_{max}$
 $AFR_{min} < AFR < AFR_{max}$
 $AIFR_{min} < AIFR < AIFR_{max}$
- values for VSG, NCSG are inside 95%-confidence interval.

VSG is measured and recorded in to EMI3000 system every two seconds with units m^3/h and in the same time VSG is normalized with PSG and TSG and is recorded with units Nm^3/h every two seconds in EMI3000 system. In order to normalise VSG, PSG (hPa) and TSG ($^{\circ}C$) are measured and recorded every two seconds. In EMI3000 system normalization of VSG is performed by formula:

$$VSG (Nm^3/h) = VSG(m^3/h) * 273 / (TSG + 273) * PSG / 1013$$

According to material balance the moisture content in the exhaust gas is 0.53 vol%. For water content of 3,35 g H_2O/kg gas (= 0.53 vol%) the dew point is $-0.7^{\circ}C$, while operating temperature in stack gas does not go below $22^{\circ}C$. Due to insignificant error it is not necessary to consider the water content in the calculation of the N_2O concentration.

According to the historical data provided in the PDD, AFR_{max} was set with units Nm^3/h (15149,2 Nm^3/h). In the EMI3000 system AFR values are monitored and stored with units kg/h . Therefore the AFR_{max} range is converted from Nm^3/h into kg/h by formula:

$$15149,2 * (17 * 1000 / 22,4 * 1000) = 11497,16 \text{ kg/h.}$$

17 (g/mol) – mole weight of ammonia
22,4 (mol/l) – volume of 1 mole

The same conversion was used for AFR_{min} range:
 $12679,4 * (17 * 1000 / 22,4 * 1000) = 9622,76 \text{ kg/h.}$

Emission reduction calculations are performed with units of AFR kg/h .

The basic formula used to calculate emission reductions by CDMN2O software is the following:

$$ER = (EF_{BL} - EF_p) * NAP_p * GWP_{N_2O}$$

ER_p = campaign specific emission reduction [t CO_2]
 EF_{BL} = N_2O Baseline Emission Factor [t N_2O / t HNO_3]
 EF_p = N_2O Production Emission Factor [t N_2O / t HNO_3]
 NAP_p = HNO_3 production during Production campaign [t HNO_3]
 GWP_{N_2O} = constant 310 [t CO_2 / t N_2O]

The intermediate calculation is as follows:

1. Calculation of Baseline Emissions

$$BE_{BC} = VSG_{BC,95\%} * NSCG_{BC,95\%} * 10^{-9} * OH_{BC} \text{ [t } N_2O]$$

BE_{BC} = N_2O Baseline Emissions [t N_2O]
 $VSG_{BC,95\%}$ = average stack flow inside 95%-confidence interval [Nm^3/h]
 $NSCG_{BC,95\%}$ = average N_2O -concentration inside 95%-confidence interval [mg/Nm^3]
 OH_{BC} = operating hours [h]

2. Calculation of Baseline Emission Factor

$$EF_{BL} = BE_{BC} / NAP_{BC} * (1 - UNC / 100\%) \text{ [t } N_2O / \text{ t } HNO_3]$$

EF_{BL} = N_2O Baseline Emission Factor [t N_2O / t HNO_3]
 BE_{BC} = N_2O Baseline Emissions [t N_2O]
 NAP_{BC} = HNO_3 Production during campaign [t HNO_3]
 UNC = total uncertainty of system [%]

3. Calculation of Campaign Emissions

$$PE_n = VSG_{n,95\%} * NSCG_{n,95\%} * 10^{-9} * OH_n \text{ [t } N_2O]$$

PE_n = N_2O Campaign Emissions [t N_2O]
 $VSG_{n,95\%}$ = average stack flow inside 95%-confidence interval [Nm^3/h]
 $NSCG_{n,95\%}$ = average N_2O -concentration inside 95%-confidence interval [mg/Nm^3]
 OH_n = operating hours [h]

4. Calculation of Campaign Emission Factor

$EF_n = PE_n / NAP_n$ [t N₂O / t HNO₃]
 EF_n = N₂O Campaign Emission Factor [t N₂O / t HNO₃]
 PE_n = N₂O Campaign Emissions [t N₂O]
 NAP_n = HNO₃ Production during campaign [t HNO₃]

5. Derivation of a moving average emission factor

Step 1

Campaign specific emissions factor for each campaign is estimated during the project's crediting period by dividing the total mass of N₂O emissions during that campaign by the total production of 100% concentrated nitric acid during that same campaign.

$$EF_n = PE_n / NAP_n \text{ (N}_2\text{O / t HNO}_3\text{)}$$

Step 2

Moving average emissions factor is calculated at the end of a campaign "n" as follows:

$$EF_{ma,n} = (EF_1 + EF_2 + \dots + EF_n) / n \text{ (N}_2\text{O / t HNO}_3\text{)}$$

The maximum of $EF_{ma,n}$ and EF_n is considered for estimation of project emissions.

3.3. Data correction

The data obtained during the downtime, malfunction or maintenance of the monitoring system was handled according to AM0034 (v02) methodology by using CDMN2O software and additional calculation sheets. All data handling during these periods is described in the JI manual for GP plant, which is used by the personnel of the plant as a reference.

3.4. Campaign length

According to the AM0034 methodology (v02), EF_{BL} has to be recalculated in two cases:

1. if $CL_{BL} > CL_{normal}$
2. if $CL_n < CL_{normal}$

where:

CL_{BL} – length of the baseline campaign
 CL_{normal} – average historic campaign length
 CL_n – length of a project campaign

According to the monitoring results:

$CL_{BL} = 299.803,81 \text{ t HNO}_3$
 $CL_{normal} = 303.129,33 \text{ t HNO}_3$
 $CL_n = 402.767,41 \text{ t HNO}_3$

$CL_n > CL_{normal}$ and $CL_{BL} < CL_{normal}$, so it is not necessary to recalculate EF_{BL} .

3.5. Impact of regulations

IPPC regulation and N₂O inclusion into the EU Emission Trading Scheme has to be taken into account when considering consistency with mandatory laws and regulations.

AB Achema operates according to the IPPC permit No 2/15. The permit was revised on April 30, 2008. It sets two kinds of N₂O emission limitations: those are total yearly emission amount and one time concentration values.

In the period of the 2nd Project campaign, GP Nitric Acid Plant's emissions of N₂O are lower than permitted emissions in the IPPC. Hence the Project fully matches the additionality requirements for JI projects.

Emission limit value (104,98 g/s) from IPPC permit is used in the recalculation of the NCSG in the baseline campaign. All data in the baseline campaign is used. A statistical procedure is applied as indicated in the methodology AM0034 and baseline emissions and EF_{BL} are recalculated for the 2nd Project campaign. No additional actions with the application of the ELV are necessary in the 2nd Project campaign.

Comparison of calculated N₂O emissions and permitted emissions according to the IPPC permit limitations in the 2nd Project campaign are done by using EF_{BL} value.

The comparison calculations show that actual N₂O emissions are lower than permitted emissions according to the IPPC permit. Further on, annual limits in the IPPC permit are lower, which may affect further campaigns.

During the 2nd Project campaign (in 2010 and 2011), N₂O is not included into the EU Emission Trading Scheme. However the Project activity considering this consistency will be affected from 2013.

4. MONITORING RESULTS

4.1. Results of the baseline campaign calculations

EVALUATION OF BASELINE			
Begin		05.09.2007 10:00	
End		28.07.2008 24:00	
Permitted data ranges from PDD			
1 Burner	OT max	769,5	⁰ C
	OT min	756	⁰ C
2 Burner	OT max	778	⁰ C
	OT min	764,1	⁰ C
3 Burner	OT max	778,7	⁰ C
	OT min	765,2	⁰ C
4 Burner	OT max	777,2	⁰ C
	OT min	761,4	⁰ C
	OP max	284	kPa
	OP min	243	kPa
	AFR max	11.497,16	kg/h
	AFR min	9.622,76	kg/h
	AIFR max	10,1	%
	AIFR min	9,3	%
Gs Normal	Johnson Matthey		
Gc Normal	95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
Gs Baseline	Johnson Matthey		
Gc Baseline	95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
UNC	5,12 %		
OH _{BC} total	7.589	h	
OH _{BC} in operation condition	5.045	h	66,48 %
VSG _{BC} (mean)	139.039,58	Nm ³ /h	5045 values
VSG _{BC} (st. dev.)	6.949,84	Nm ³ /h	
VSG _{BC} (mean 95 %)	139.117,38	Nm ³ /h	4826 values
NCSG _{BC} (mean)	2.634,69	mg/Nm ³	4980 values
NCSG _{BC} (st. dev.)	167,75	mg/Nm ³	
NCSG _{BC} (mean 95 %)	2.643,65	mg/Nm ³	4793 values
NAP_{BC}	299.803,81 t HNO₃		
BE_{BC}	2.791,066 t N₂O		
EF_{BL}	0,008833 T N₂O / tHNO₃		

Calculations of baseline emissions are presented in file “*baseline calculation and evaluation V.5.0. 01-07-2011*”.

4.2. Results of the project campaign calculations

EVALUATION OF PROJECT CAMPAIGN No. 2			
Begin	25.01.2010 24:00		
End	16.06.2011 22:00		
Type	Project line		
Status	Calculated		
Gs Normal	Johnson Matthey		
Gc Normal	95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
Gs Baseline	Johnson Matthey		
Gc Baseline	95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
Gs Project line	Johnson Matthey		
Gc Project line	95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
OH total	10.962 h		
VSG (mean)	135.525,43	Nm ³ /h	10962 values
VSG (st. dev.)	9.470,58		
VSG (mean 95 %)	136.484,54	Nm ³ /h	10553 values
NCSG (mean)	391,07	mg/Nm ³	10962 values
NCSG (st. dev.)	152,63		
NCSG (mean 95 %)	377,90	mg/Nm ³	10573 values
NAP _n total	402.767,41 t HNO ₃		
NAP _n 2010 year	264.519,81 t HNO ₃		
NAP _n 2011 year	138.247,60 t HNO ₃		
PE _n	565,3945 t N ₂ O		
EF _n	0,001404 tN ₂ O / tHNO ₃		
EF _{BL}	0,008833 tN ₂ O / tHNO ₃		
ER 2010 (25.01.10-31.12.10)	609.205 t CO ₂		
ER 2011 (01.01.11-16.06.11)	318.393 t CO ₂		
ER total (25.01.10-16.06.11)	927.598 t CO₂		

Calculations of 2nd project campaign emissions are presented in file "2st project line calculation and evaluation V.1.0. 01-07-2011"

* Values of ER 2010 year and of ER 2011 year are rounded to 2 digits after coma, therefore is small deviation between sum of these figures (ER 2010 and ER 2011) and figure of ER total.

5. EMISSION REDUCTION CALCULATIONS

5.1. Baseline emissions

$$BE_{BC} = 139.117,38 * 2.643,65 * 10^{-9} * 7.589 = 2.791,066 \text{ t N}_2\text{O}$$

$$EF_{BL} = 2.791,066 / 299.803,81 * (1 - 5,12 / 100\%) = 0,008833 \text{ t N}_2\text{O} / \text{t HNO}_3$$

5.2. Project emissions

$$PE_n = 136.484,54 * 377,90 * 10^{-9} * 10.962 = 565,394 \text{ t N}_2\text{O}$$

$$EF_n = 565,394 / 402.767,41 = 0,001404 \text{ t N}_2\text{O} / \text{t HNO}_3$$

$$EF_1 = 0,001066 \text{ t N}_2\text{O} / \text{t HNO}_3$$

$$EF_n = 0,001404 \text{ t N}_2\text{O} / \text{t HNO}_3$$

$$EF_{ma,n} = (0,001066 + 0,001404) / 2 = 0,001235 \text{ tN}_2\text{O} / \text{t HNO}_3$$

If $EF_{ma,n} < EF_n$, then EF_n is used for further calculations of project emission reductions.

5.3. Illustration of emission reduction calculations

$$ER = (0,008833 - 0,001404) * 402.767,41 * 310 = 927.597,51 \text{ t CO}_2$$

5.4. Remarks

The above calculated amount of emission reductions was generated during the monitoring period of the 2nd Project campaign from January 25, 2010 till June 16, 2011 (507 days).

Calculated amount of ER in current monitoring period exceeds the amount estimated in the registered PDD due to the following reasons:

- 1) higher efficiency of the secondary catalyst than projected;
- 2) lack of precise N₂O concentration measurements at the pre-project phase;
- 3) longer project campaign.

The projected efficiency of the secondary catalyst was 80% N₂O abatement. This figure was used as a conservative approach, based on the minimum efficiency guaranteed by the manufacturer. The actual efficiency during the second project campaign reached up to 84% (the efficiency during the first project campaign was 88%).

In order to project N₂O emission reductions, a stationary analyser SICK-Mayhak UNOR 6N (infrared) was used to measure N₂O concentration in the tail gas flow in April 2007. At that time, measurement results gave short term average N₂O concentration of 2.119,16 mg/Nm³, which translated into 7,07 kg/tHNO₃. The actual concentration (NCSG_{mean95%}) during the revised baseline campaign was 2.643,65 mg/Nm³ and emission factor was 8,8 kg/tHNO₃. This resulted

60% lower projected ER compared to the actual ER of the 2nd project campaign (projected ER were lower by 21% than actual ER during the 1st project campaign).

$$ER = (EF_{BL} - EFP) * NAP_P * GWP_{N2O}$$

$$ER_{Projected} = (0,00707 - 0,001414) * 330.000 * 310 = 578.608,8 \text{ t CO}_2$$

$$ER_{Actual} = (0,008833 - 0,001404) * 402.767,41 * 310 = 927.597,51 \text{ t CO}_2$$

For projected emission reductions, EFP was calculated based on projected efficiency of the secondary catalyst of 80% i.e. 20% of the projected EF_{BL} which results in 0,001414 tN₂O/ tHNO₃.

Since initial measurements back in 2007 were performed during only one week's time it is likely that the time was too short to precisely define emission values. Also, the purpose of the measurements at that time was to get some data in order to make a forecast for future project emissions but not to perform precise calculations. These reasons resulted in lower ER forecast than it proved to be the reality.

Projected emissions in the PDD were calculated on a yearly basis not for campaigns. Therefore a campaign length does not correspond with a calendar year. The 2nd Project campaign took place 507 days, which resulted in NAP equal to 402.767,41 t HNO₃.

Annex I – AM0034 configuration with 2008 QAL2

ACHEMA Jonova, Line 1 003 Production (25.01.10 24:00 - 16.06.11 22:00)

Date: 6/27/2011
Page: 1

Configuration 01

Campaign Data

		Minimum	Maximum
Type	: project	OT : 0.00 °C	1000.00 °C
Status	: calculated	OP : 0.00 kPa	1000.00 kPa
Start	: 25.01.2010 24:00	AFR :	20000.00 t NH3/h
Stop	: 16.06.2011 22:00	AIFR :	15.00 %
UNC	: 5.12 %		
Cl.Normal	: 303129.330 t		
GS.Normal	: Johnson Matthey		
GC.Normal	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
GS.Baseline	: Johnson Matthey		
GC.Baseline	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
GS.Project	: Johnson Matthey		
GC.Project	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		

			Range [min]		Range [max]		Gradient		Zero-Offset		Std.Deviation		Factor
			low	high	low	high	low	high	low	high	low	high	
NCSG	[F1]NCSG[L]IR	post calc.	0.000	980.000	-0.010	3920.150	61.2	244.8	-244.8	-979.3	13	13	1
VSG.oc	[F1]VSG.opcond	post calc.	0.000	218506.000	-	-	15026.9	0	-60107.6	0	0	0	1
PSG	[F1]PSG	post calc.	0.000	1600.000	-	-	99.07	0	-396.3	0	0	0	1
TSG	[F1]TSG	post calc.	0.000	400.000	-	-	25.29	0	-101.1	0	0	0	1
VSG.1.oc		none	-	-	-	-	-	-	-	-	-	-	1
PSG.1		none	-	-	-	-	-	-	-	-	-	-	1
TSG.1		none	-	-	-	-	-	-	-	-	-	-	1
VSG.2.oc		none	-	-	-	-	-	-	-	-	-	-	1
PSG.2		none	-	-	-	-	-	-	-	-	-	-	1
TSG.2		none	-	-	-	-	-	-	-	-	-	-	1
OH	[F1]Op.Time	direct	-	-	-	-	-	-	-	-	-	-	1
OT	[F1]OT	direct	-	-	-	-	-	-	-	-	-	-	1
OP	[F1]OP	direct	-	-	-	-	-	-	-	-	-	-	1
AFR	[F1]AFR	direct	-	-	-	-	-	-	-	-	-	-	1
AIFR	[F1]AIFR	direct	-	-	-	-	-	-	-	-	-	-	1
C[NAP]	[F1]C[HNO3]	post calc.	0.000	100.000	-	-	0	0	100	0	0	0	1
NAP(op)	[F1]NAP.input	direct	-	-	-	-	-	-	-	-	-	-	0.001

Annex II – AM0034 configuration with 2010 QAL2

ACHEMA Jonova, Line 1

003 Production (25.01.10 24:00 - 16.06.11 22:00)

Date: 6/27/2011
Page: 1


Configuration 02

Campaigne Data

		Minimum	Maximum
Type	: project	OT : 0.00 °C	1000.00 °C
Status	: calculated	OP : 0.00 kPa	1000.00 kPa
Start	: 25.01.2010 24:00	AFR :	20000.00 t NH3/h
Stop	: 16.06.2011 22:00	AIFR :	15.00 %
UNC	: 5.12 %		
Cl.Normal	: 303129.330 t		
GS.Normal	: Johnson Matthey		
GC.Normal	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
GS.Baseline	: Johnson Matthey		
GC.Baseline	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		
GS.Project	: Johnson Matthey		
GC.Project	: 95% Pt/5%Rh (Gauze 1-3), 37%Pt/60%Pd/3%Rh (Gauze 4)		

			Range [min]		Range [max]		Gradient		Zero-Offset		Std.Deviation		Factor
			low	high	low	high	low	high	low	high			
NCSG	[F1] NCSG[L].IR	post calc.	0.000	980.000	-0.010	3920.150	61.2	244.8	-244.8	-979.3	13	13	1
VSG.oc	[F1] VSG.opcond	post calc.	0.000	218506.000	-	-	14594.7	0	-58378.8	0	0	0	1
PSG	[F1] PSG	post calc.	0.000	1600.000	-	-	100.18	0	-400.72	0	0	0	1
TSG	[F1] TSG	post calc.	0.000	400.000	-	-	24.8	0	-99.19	0	0	0	1
VSG.1.oc		none	-	-	-	-	-	-	-	-	-	-	1
PSG.1		none	-	-	-	-	-	-	-	-	-	-	1
TSG.1		none	-	-	-	-	-	-	-	-	-	-	1
VSG.2.oc		none	-	-	-	-	-	-	-	-	-	-	1
PSG.2		none	-	-	-	-	-	-	-	-	-	-	1
TSG.2		none	-	-	-	-	-	-	-	-	-	-	1
OH	[F1] Op.Time	direct	-	-	-	-	-	-	-	-	-	-	1
OT	[F1] OT	direct	-	-	-	-	-	-	-	-	-	-	1
OP	[F1] OP	direct	-	-	-	-	-	-	-	-	-	-	1
AFR	[F1] AFR	direct	-	-	-	-	-	-	-	-	-	-	1
AIFR	[F1] AIFR	direct	-	-	-	-	-	-	-	-	-	-	1
C[NAP]	[F1] C[HNO3]	post calc.	0.000	100.000	-	-	0	0	100	0	0	0	1
NAP(op)	[F1] NAP.input	direct	-	-	-	-	-	-	-	-	-	-	0.001

Annex III – Scheme of responsibilities

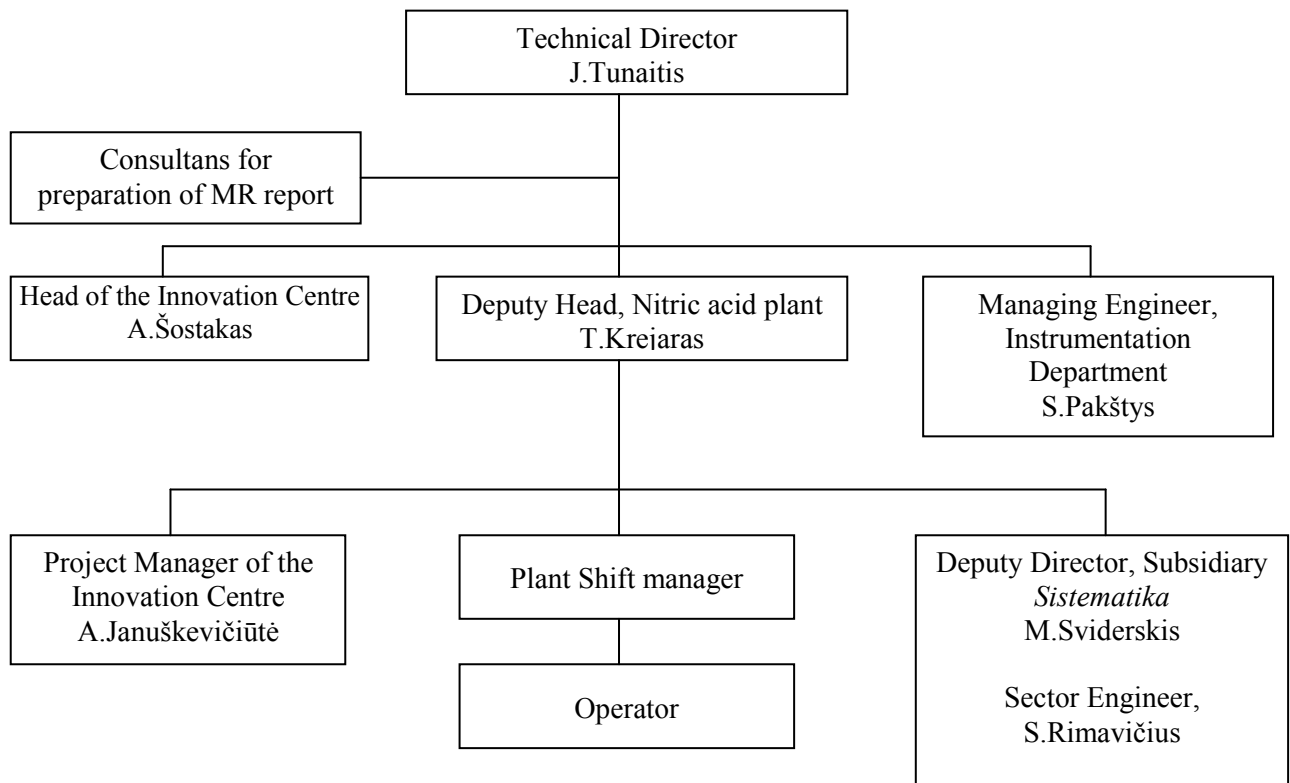

The overall responsibility is represented by the Technical director of AB ACHEMA.

The monitoring process is under the responsibility of the Nitric Acid Plant Deputy Head. The description of these activities is provided in the JI Project Manual for GP Plant. This document is included in the plant quality management system and is available to the audit team. The Nitric Acid Plant Deputy Head and Plant Shift Manager are responsible for data collection during the plant operation.

The monitoring data is processed, validated, adjusted, if necessary, and recorded. The Nitric Acid Plant Deputy Head is in charge of programming all formulae in the spreadsheets which are used for calculation. The Plant Shift Managers process the data, check the data for consistency, validate and record it every day in electronic and paper form. In case of failure of a monitoring equipment, staff of Subsidiary “Sistematika” is responsible for troubleshooting according to JI Procedures Manual “Troubleshooting Procedure”. The Nitric Acid Plant Deputy Head adjusts the data according to the JI Project Manual for GP Plant. In case the failure is not covered by the procedure, the Nitric Acid Plant Deputy Head makes the decision to correct the figures or to abandon the data.

The Nitric Acid plant Deputy Head is responsible for archiving the data. Data in electronic form is stored in EMI3000 system computer which contains two hard discs with mirror function (RAID0), additional data are stored in external hard disc drive, which is installed in remote control of GP department. Data collected in electronic form are printed from EMI 3000 system computer every day and are stored in GP department Head’s office (performed by Head of GP department). Both,

original document and the backup file are kept up to 2 years after the end the project crediting period.

Additionally N₂O monitoring system parameter data is collected in Foxboro system and at the end of the month is stored in data discs (DVD), which are stored in the room of Head Deputy of the Plant.

The N₂O monitoring parameters via Foxboro system are observed by DVP operator of GP unit. In case of deviations from normal values DVP operator should inform GP unit chief operator and shift engineer. Shift engineer takes actions in order to eliminate malfunction.

Calculation and validation of emission reductions is done after each campaign by the Nitric Acid Plant Deputy Head, by the consultants or by their assistance. In two latter cases all calculations are reconciled with the Nitric Acid Deputy Head.

The roles and responsibilities of other persons, which are represented in scheme, are provided below:

Consultants prepare monitoring reports and corresponding calculations of emission reductions and explanation sheets, which are reconciled with the Nitric Acid Deputy Head.

The Managing Engineer of Instrumentation Department of AB ACHEMA is responsible for coordination of N₂O monitoring-related issues.

The Deputy Director of Subsidiary “Sistematika” is responsible for the control of the maintenance of the monitoring system, compliance with the operation rules for measurement and automation instruments, and for the analysis of the monitoring system failures.

The Sector Engineer of Subsidiary “Sistematika” is responsible for assurance of correct operation of the monitoring system, for the arrangement of the compliance with QAL3 procedure, for preparation of manuals and internal maintenance procedures for the monitoring system, for keeping in touch with service providing organisations on the issues of monitoring system troubleshooting and maintenance.

The Head of the Innovation Centre is responsible for coordination of the JI-Project-involved departments, for collaboration with JI partners, for control of funds for JI Project and he is contact person with JISC.

The Project Manager of the Innovation Centre is responsible for arrangement of meetings, for conclusion of agreements, their coordination and fulfillment; he is also the contact person for project’s correspondence.